

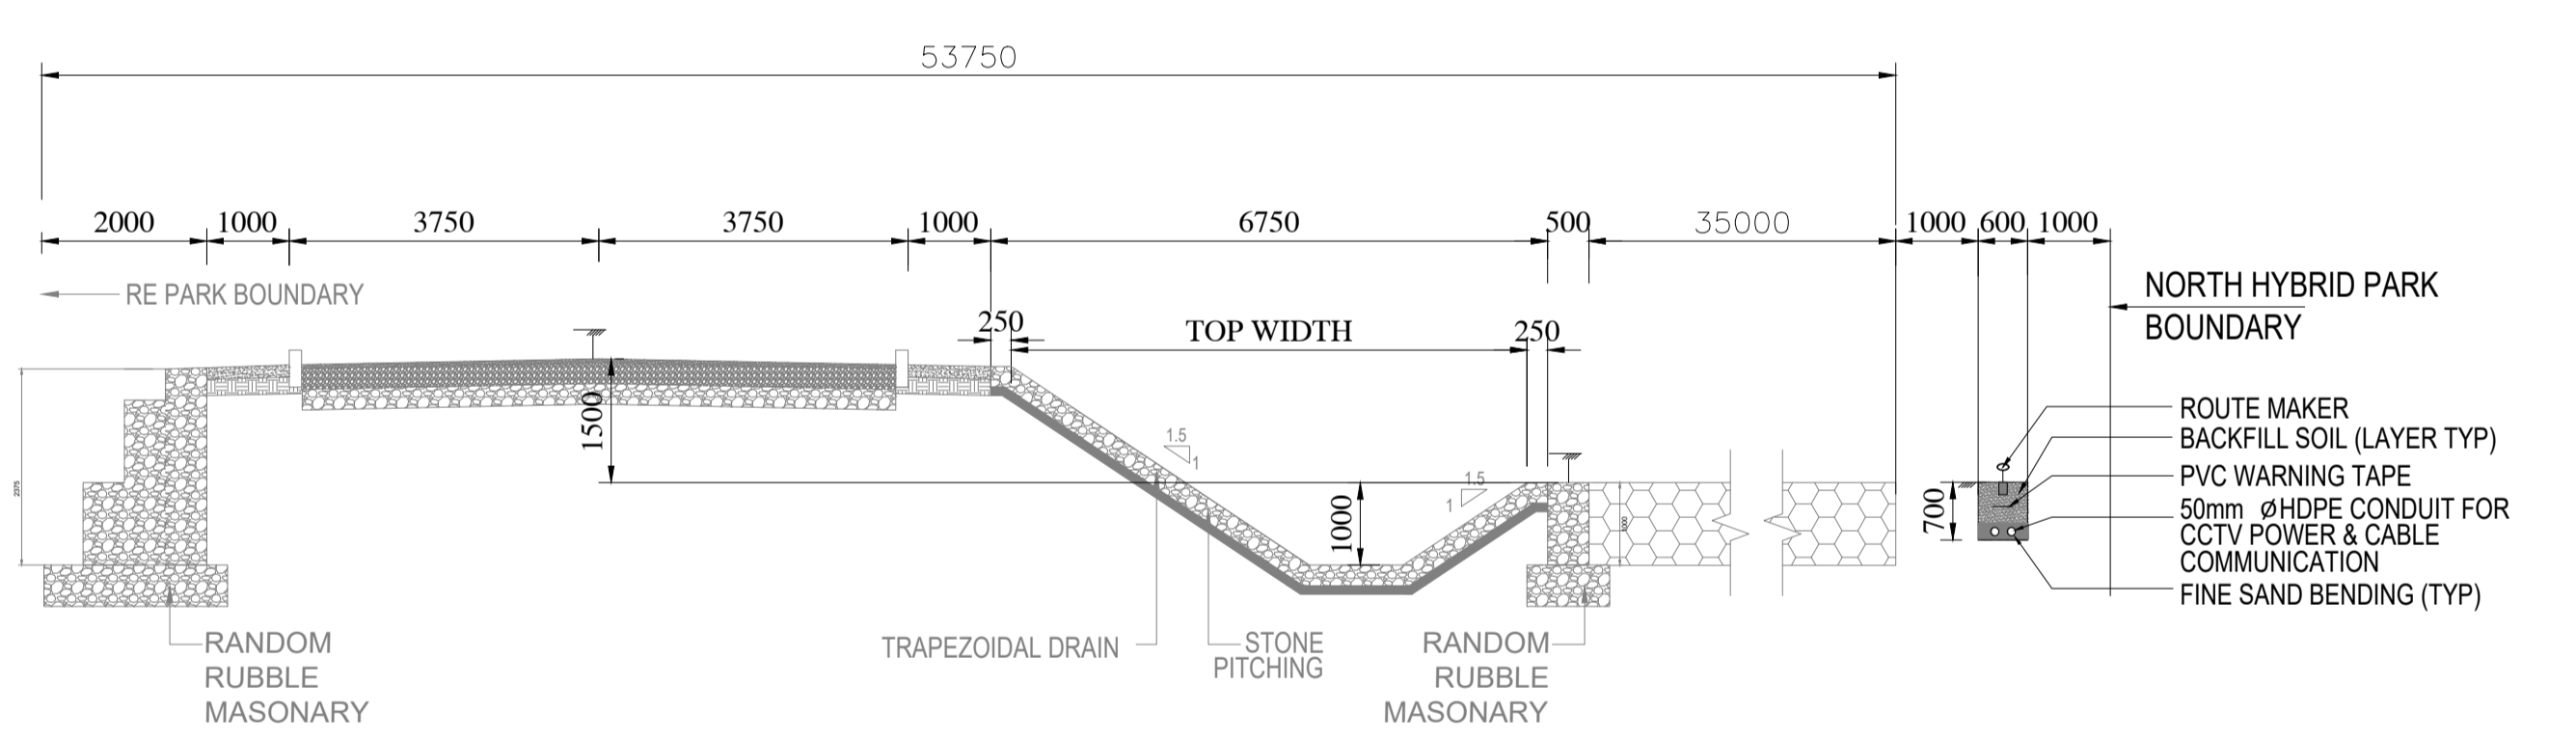
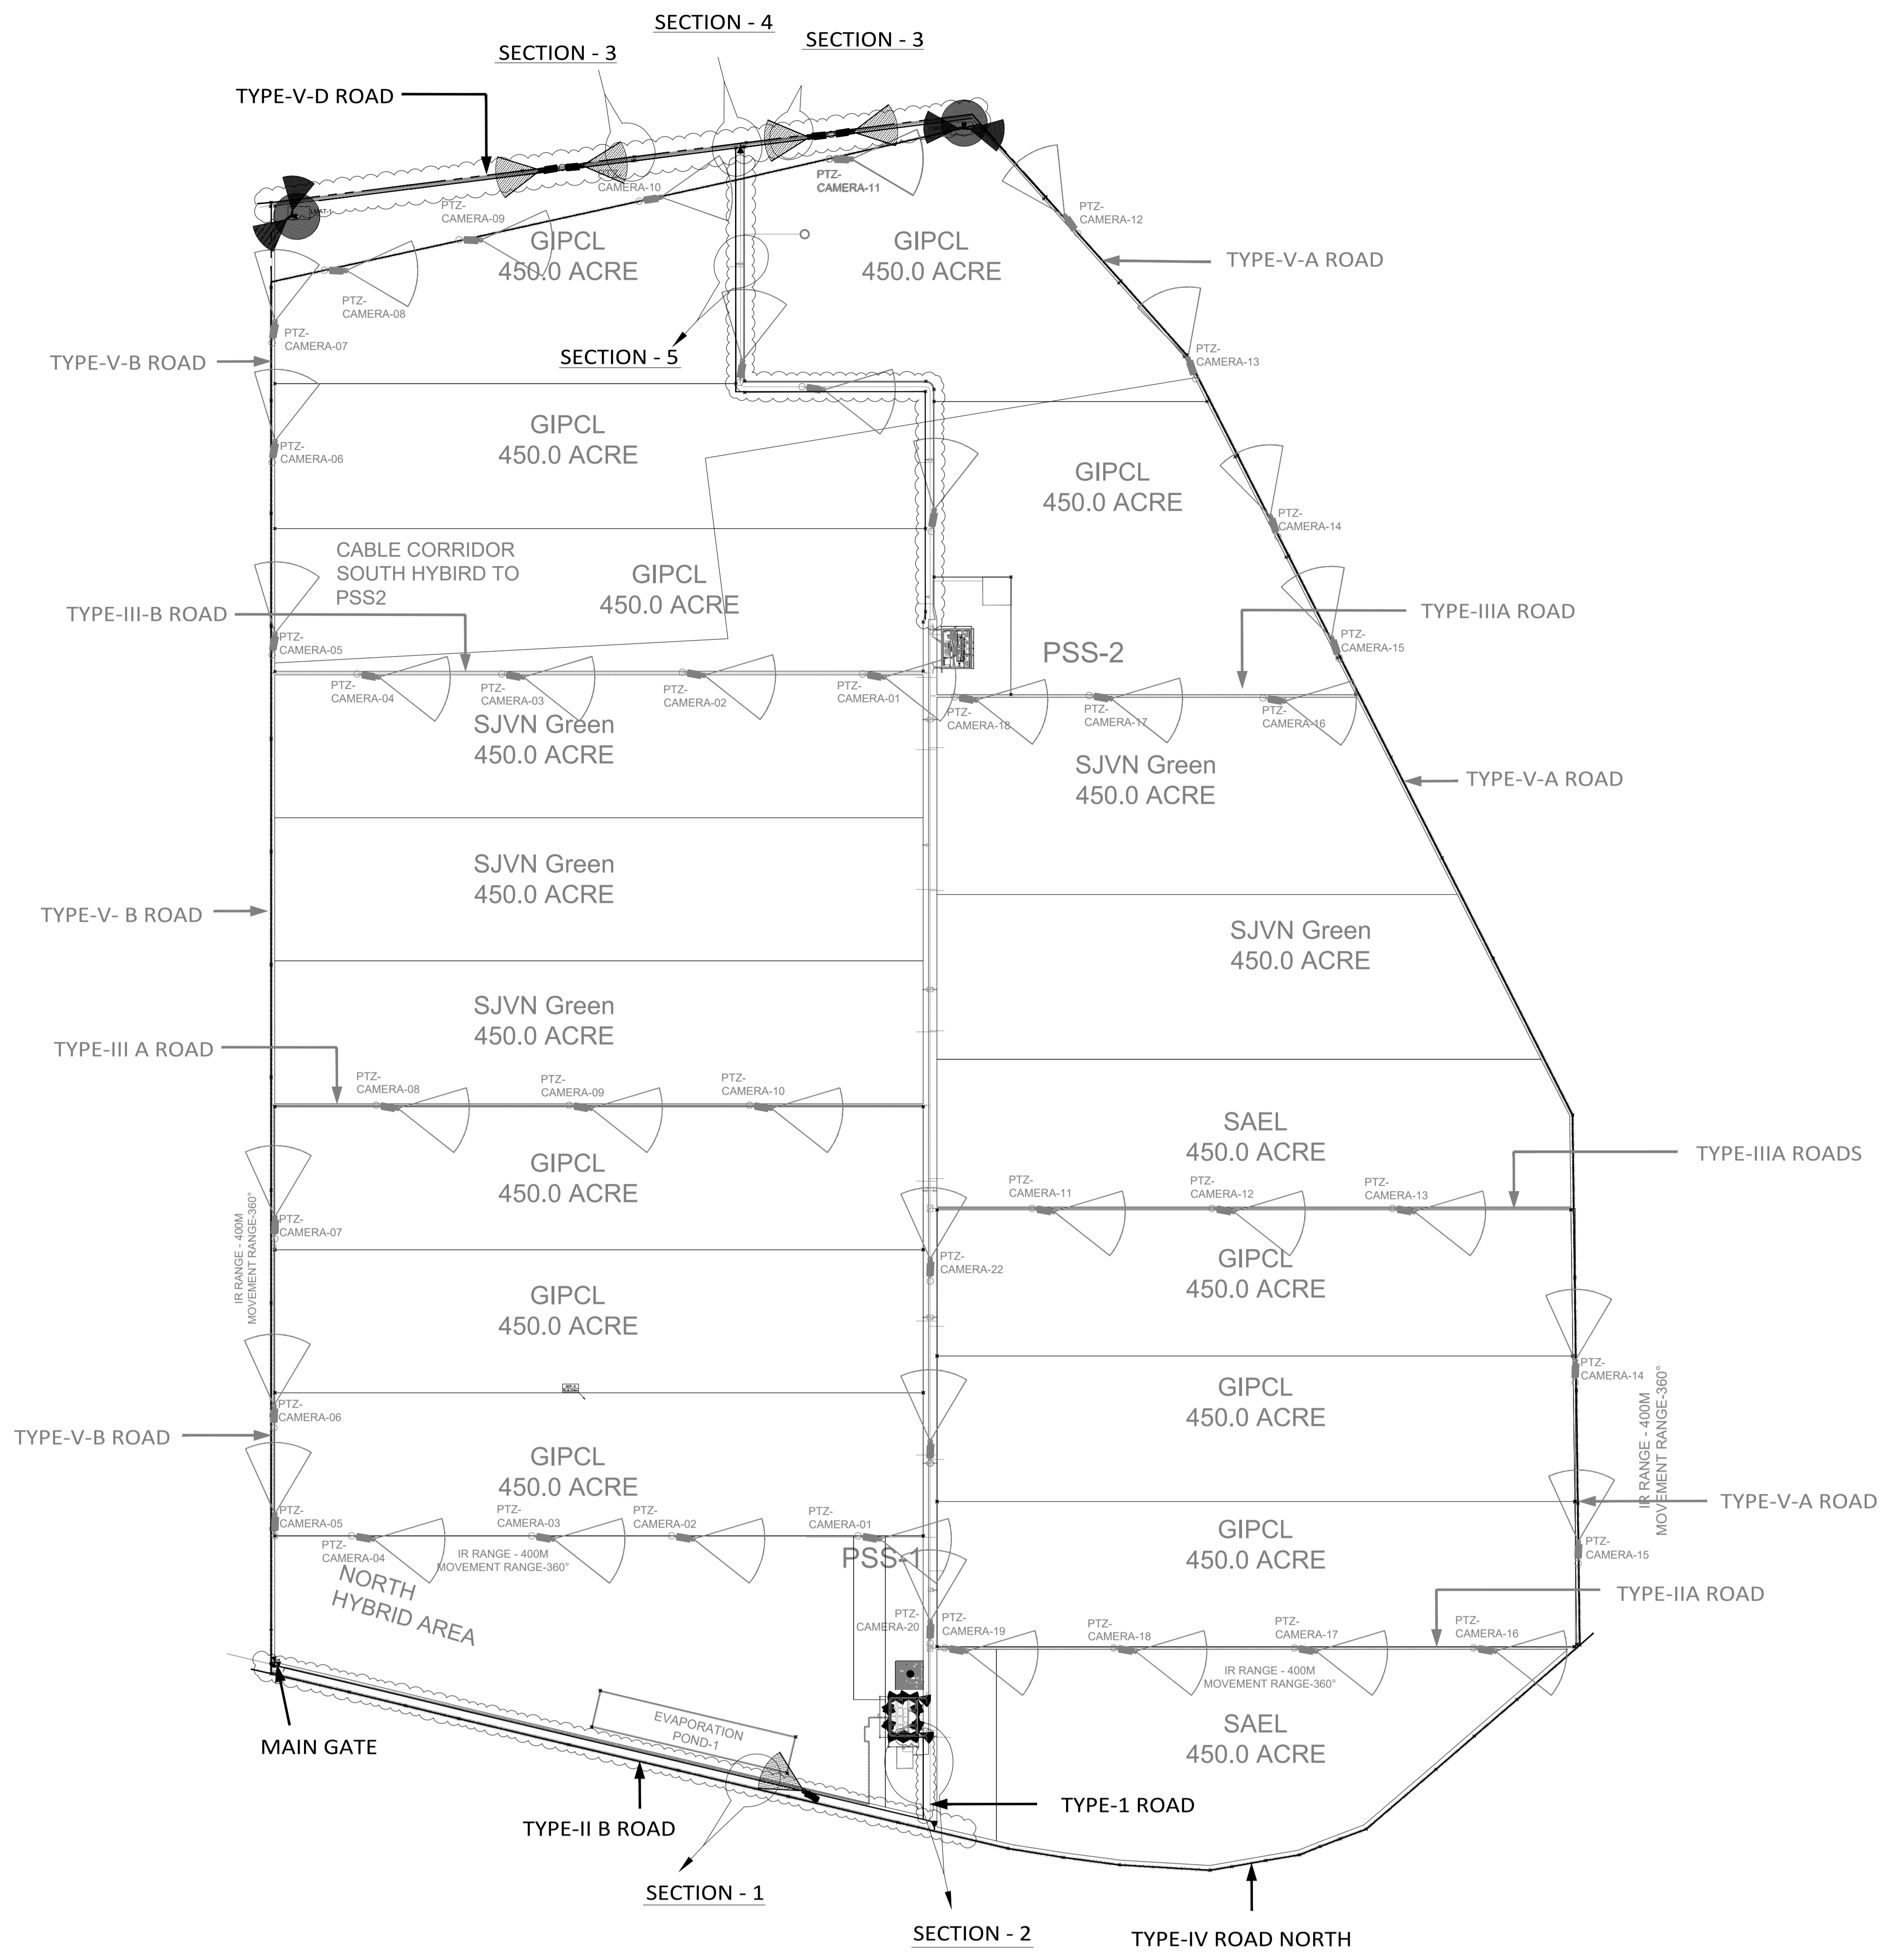



OVERALL PLAN (NORTH BLOCK) - CCTV CABLE ROUTE

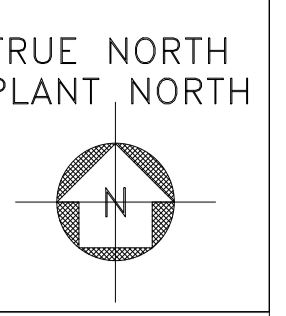


SECTION - 1 CCTV CABLE FROM T - JUNCTION TO SGC

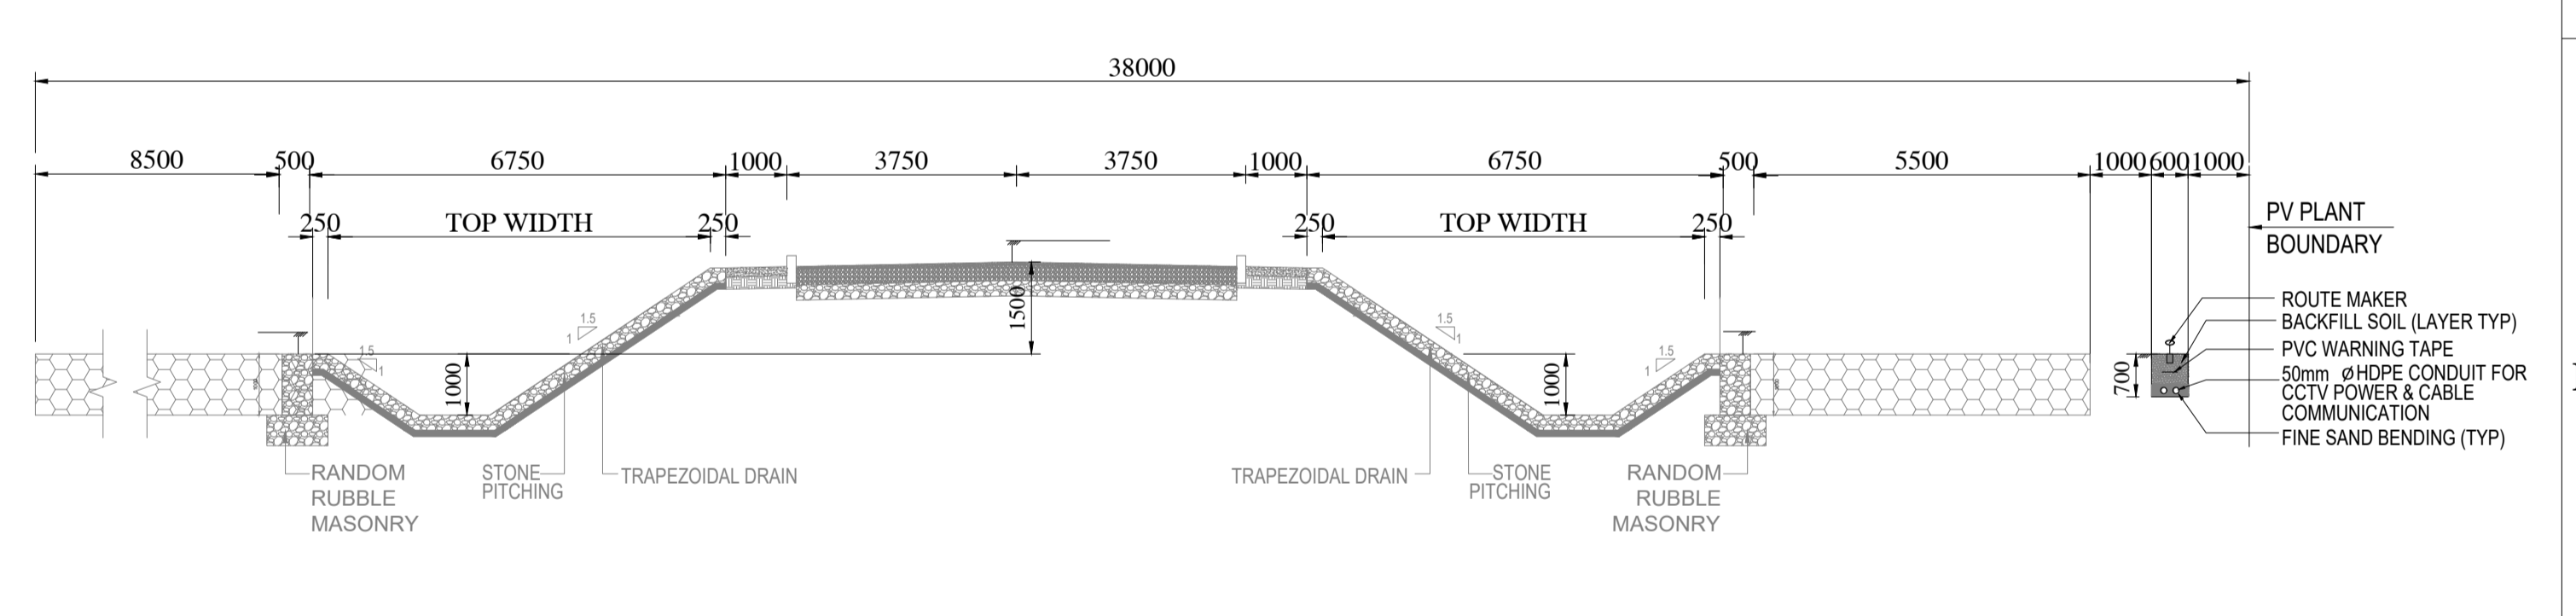


SECTION - 5 CCTV CABLE FROM NORTH BOUNDARY TO PSS - 2

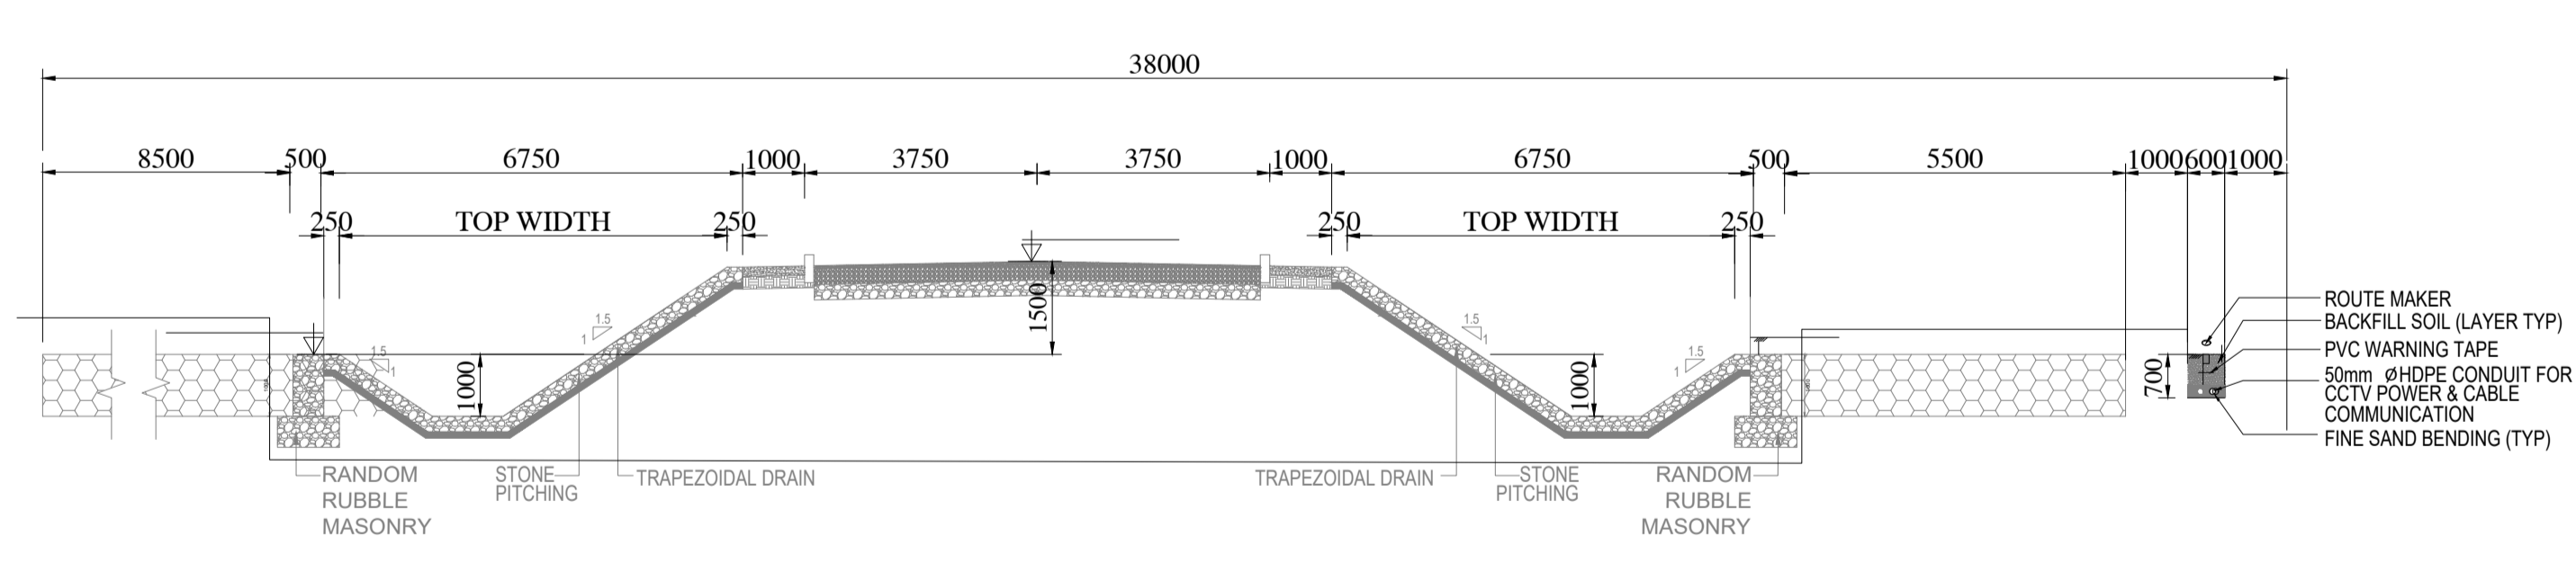


SECTION - 4 CCTV CABLE ROAD CROSSING T - JUNCTION ROAD

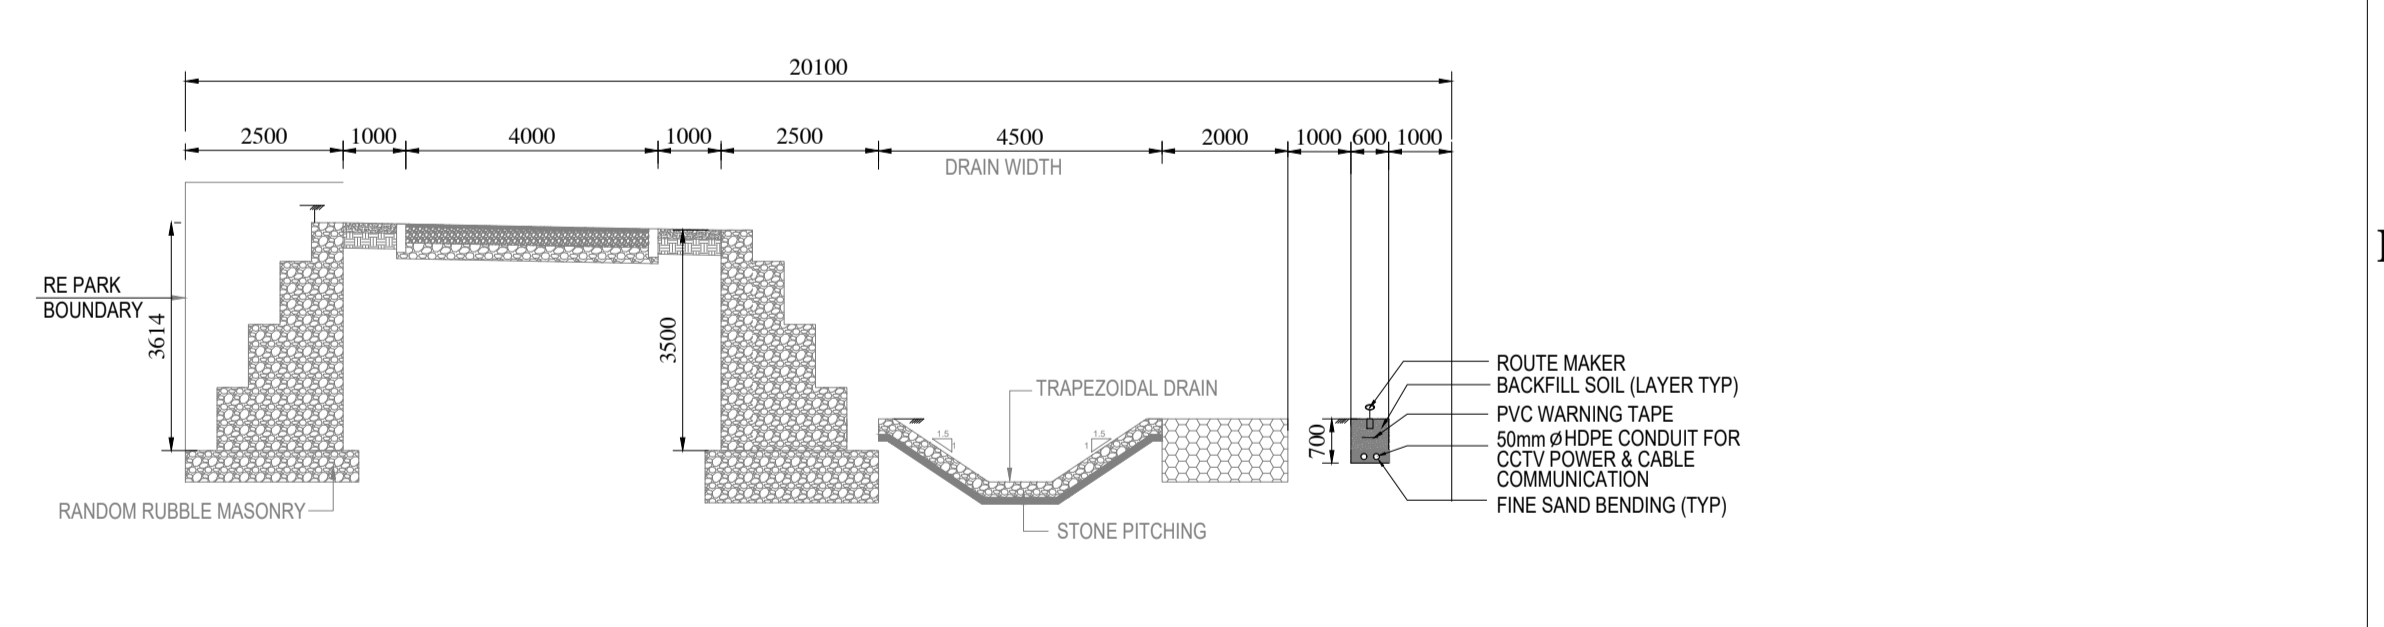

SECTION - 3 CCTV CABLE FROM PHY - 08,09,10 TO - PHY CAM - 05

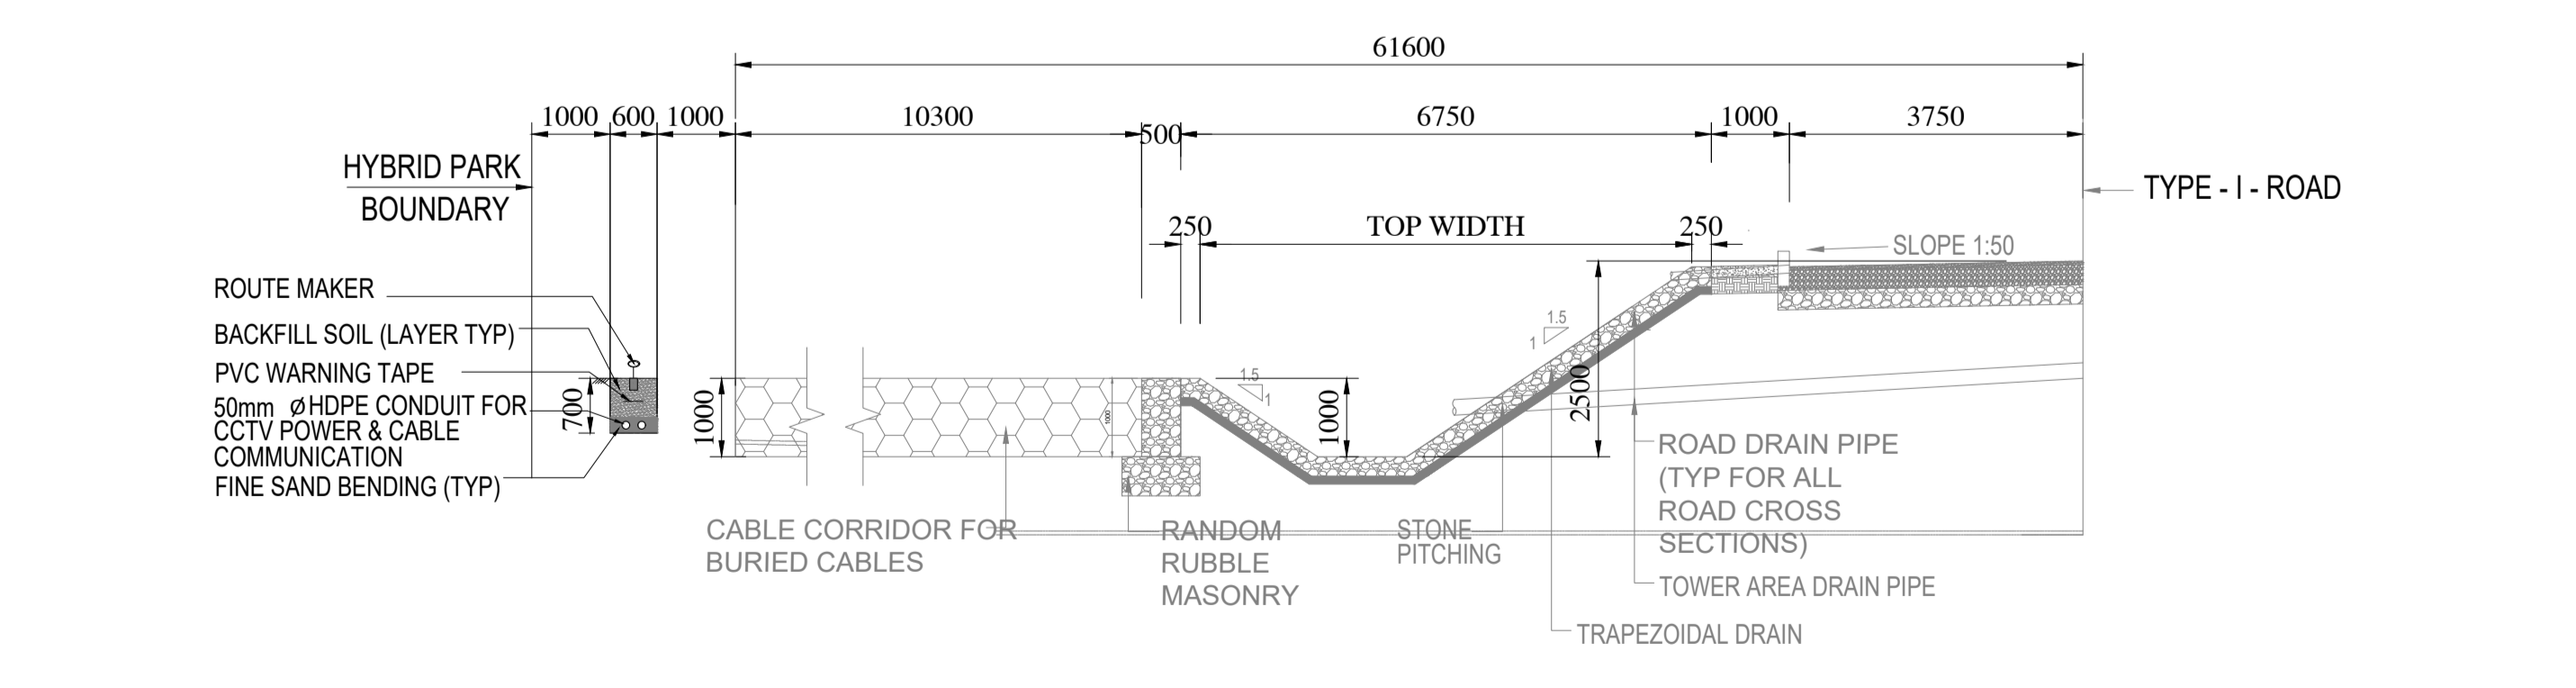

SECTION - 2 CCTV CABLE FROM PSS - 1 TO T - JUNCTION AT TYPE - 1 ROAD

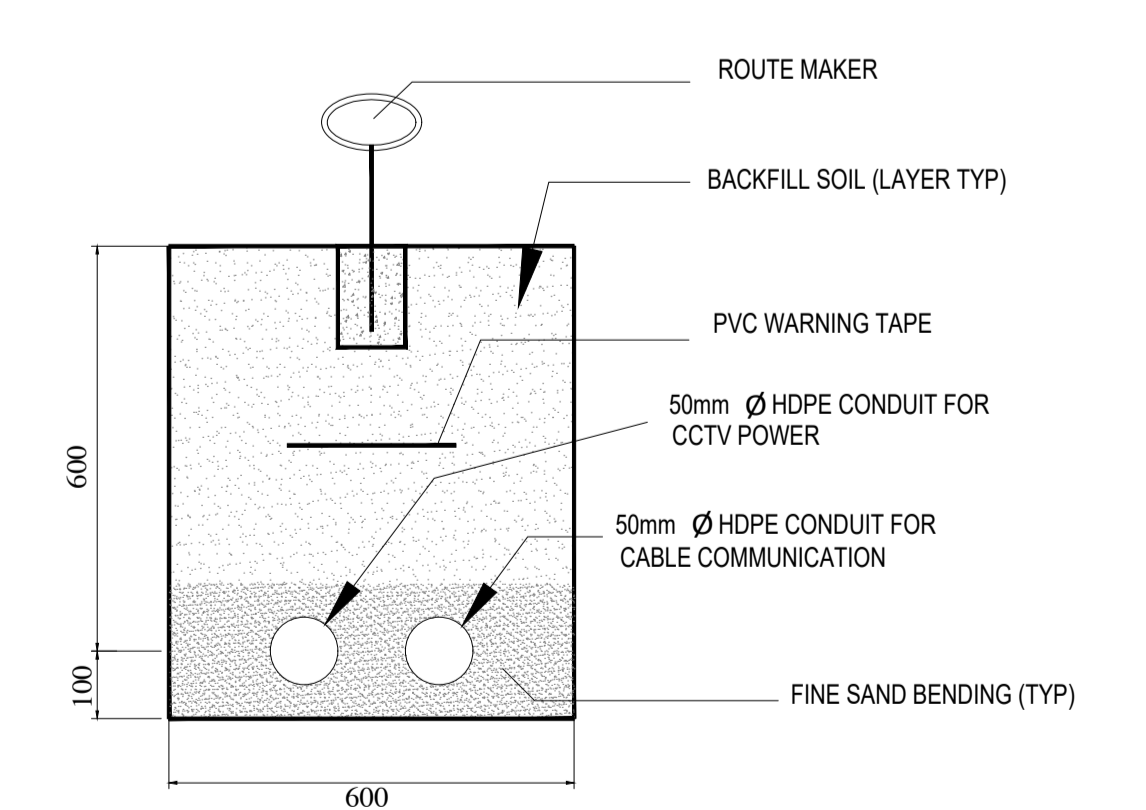

CCTV CABLE TRENCH CROSS SECTION DRAWING

NOTES:-

- CABLE ROUTE ARE TENTATIVE, IT SHALL BE DECIDED DURING DETAIL ENGINEERING.
- THE BIDDER SHALL ADHERE TO THE EXISTING CABLE ROUTING AS DESIGNATED BY GIPCL INSIDE POLLING SUBSTATION 1 AND 2.
- IN CASES WHERE CABLE ROAD CROSSINGS ARE REQUIRED AND A DIRECT CROSSING IS NOT FEASIBLE DUE TO THE ABSENCE OF A CULVERT, THE BIDDER SHALL OBTAIN PRIOR PERMISSION FROM GIPCL. SUBSEQUENTLY, THE BIDDER SHOULD ADJUST THE LOCATION OF THE CCTV CAMERA TO ENSURE UNINTERRUPTED COVERAGE, MAINTAINING CONSISTENCY WITH THE ORIGINALLY PROPOSED POSITIONING.

FOR TENDER PURPOSE ONLY

REV.	DATE	DESCRIPTION	DRN.	STR.	MECH.	ELEC.	INST.	APPROVED BY
3	27-01-2026	ISSUED FOR APPROVAL						VU
2	06.11.2025	ISSUED FOR APPROVAL						VU
1	26.09.2025	ISSUED FOR APPROVAL						VU
0	26.09.2025	ISSUED FOR APPROVAL						VU

CONSULTANT: FICTNER INDIA Consulting Engineers (India) Private Limited Chennai, Bengaluru	CLIENT NAME:- GUJARAT INDUSTRIES POWER CO. LTD 2375 MW CAPACITY SOLAR/WIND/HYBRID RENEWABLE ENERGY PARK AT GREAT RANN OF KUTCH AREA, GUJARAT
DRAWN: VU DESIGNED: NKJ CHECKED: SKP DEPT HEAD: SK PROJ MGR: RP	TITLE: CCTV CABLE ROUTE LAYOUT AND CROSS SECTION DRAWING
PRELIMINARY TENDER ENGINEERING CONSTRUCTION	DEPT.: JOB NO. 2022411 SCALE: SHEET: REV.
RELEASED FOR	DWG. NO. FCE-1721125-EL-DWG-LAY-4100-002 SHEET No. 01 OF 02