



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

## **GUJARAT INDUSTRIES POWER COMPANY LIMITED**

### **(Surat Lignite Power Plant)**

**AT & POST NANI NAROLI, TALUKA: MANGROL,**

**DIST: SURAT, PIN 394 110 (GUJARAT)**


**Phone Nos.: EPABX (02629) 261063 to 261072,**

**Fax Nos.: (02629) 261112, 261080**

Tender document for;

**Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at Ash Handling System at Surat Lignite Power Plant - 4 x 125 MW.**

***Bid No.: SLPP / AHS / TELESCOPIC SPOUT / 2020-21***

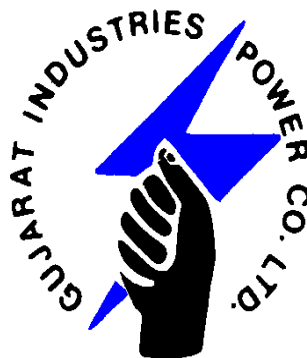

## **INSTRUCTIONS TO BIDDERS & CONDITIONS OF CONTRACT**



**Tender Document for** : Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

## **INDEX**

<b><u>Sr. No.</u></b>	<b><u>PARTICULARS</u></b>	<b><u>PAGE NO.</u></b>	
		<b><u>From</u></b>	<b><u>To</u></b>
(1)	<b><u>NOTICE INVITING TENDER (NIT)</u></b>	3	4
(2)	<b><u>SECTION - A</u> (Instructions to Bidders)</b>	5	27
(3)	<b><u>SECTION - B</u> (Instructions to Bidders for online Tendering)</b>	28	28
(4)	<b><u>SECTION - C</u> (General Conditions of Contract)</b>	29	49
(5)	<b><u>SECTION - D</u> (Special Conditions of Contracts)</b>	50	68
(6)	<b><u>SECTION - E</u> (Schedule of Quantities &amp; Price)</b>	69	70
(7)	<b><u>SECTION - F</u> (Annexure and Forms)</b>	71	86

### **NOTE:**

All the Bidders should study entire Tender documents carefully & may carry out Plant visit before quoting & submitting their online Bid to understand scope of work and its importance.



**Tender Document for** : Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

## **NOTICE INVITING TENDER (NIT)**

(Tender No.: SLPP / AHS / TELESCOPIC SPOUT / 2020-21)

Name of work	Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for Fly Ash Unloading Silo at Ash Handling System.
Place of work	Surat Lignite Power Plant, Village: Nani Naroli, Taluka: Mangrol, Dist.: Surat- 394 110 (Gujarat).
Quantity	The successful Bidder will be awarded this contract involving total quantities of various items as mentioned against item descriptions in BOQ (Section-E).
Contract period	Contract period shall be Twelve (12) Months starting from date of Letter of Intent (LoI) / Work Order.
EMD	<b>Rs.17,000/-</b> (Rupees Seventeen Thousand only) by Demand Draft payable at SBI Nani Naroli only or Bank Guarantee in favor of GIPCL from approved Banks mentioned in this tender or through RTGS or through online payment gateway of company's website: <a href="http://www.gipcl.com">www.gipcl.com</a> (online Payment Form) as mentioned in this tender in subsequent clauses.
Cost of Tender Document / Tender Fee	<b>Rs.2,950/-</b> (Rupees Two Thousand Nine hundred Fifty only) – non refundable Demand Draft payable at SBI Nani Naroli only, through RTGS or through online payment gateway of company's website: <a href="http://www.gipcl.com">www.gipcl.com</a> (online Payment Form) as per details mentioned in this tender in subsequent clauses.
Availability of online E-Tender document	On GIPCL's E-Tender portal: <a href="http://etender.gipcl.com/">http://etender.gipcl.com/</a> from <b>23.02.2021</b> .
Last date of online submission of offer	<b>15.03.2021</b> (up to 17:30 hours) On GIPCL's E-Tender portal: <a href="http://etender.gipcl.com/">http://etender.gipcl.com/</a>
Submission of EMD, Tender fee RTGS detail and other supporting documents for technical Bid in physical form at address given in tender.	On or before <b>15.03.2021 up to 17:30 hrs.</b> during office hours at office of Surat Lignite Power Plant, Nani Naroli, Dist. Surat.



**Tender Document for** : Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

## **NOTES:**

1. Amendment / corrigendum of the Tender Document, forms, schedules, etc. may be done any time by the GIPCL during the period of publication of Tender on the website. The Bidders are required to visit the website regularly till the last date & time of Bid submission.
2. GIPCL reserves the right to reject any or all the tenders without assigning any reason thereof.
3. The Bidders are required to quote the rate strictly as per the terms and conditions mentioned in the tender document, adhering to technical specifications as well.
4. The Bidders are required to submit their Bids online only through GIPCL's E-Tender portal: <http://etender.gipcl.com/> and website [www.gipcl.com](http://www.gipcl.com).
5. The EMD, Tender fee & other supporting documents are to be submitted in physical form only at the following address:-

**General Manager (SLPP)**  
**Gujarat Industries Power Company Limited,**  
**Surat Lignite Power Plant,**  
**At Village: Nani Naroli, Taluka: Mangrol,**  
**Dist.: Surat - 394 110, Gujarat.**  
**Phone: (02629) 261063 - 72**  
**E-Mail: [opsharma@gipcl.com](mailto:opsharma@gipcl.com).**



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

## **SECTION-A**

### **INSTRUCTIONS TO BIDDERS**

#### **1. PLANT SYNOPSIS**

Gujarat Industries Power Company Limited (GIPCL) (henceforth be named Company/GIPCL), is a Premier Power Utility in the State of Gujarat with an installed capacity of 1084.4 MW comprising of various conventional and renewable projects.

GIPCL commissioned its first power project: a 145 MW has based combined cycle power plant in 1992 at Vadodara. It expanded its capacity 165 MW Neptha and Gas based Combine Cycle Power Plant at Vadodara in 1997. GIPCL has commissioned 1MWp Distributed Solar Power Projects at two locations in Gujarat viz. at Village: Amrol, Dist.: Anand and at Village Vastan, Taluka Mangrol, and Dist.: Surat.

Surat Lignite Power Plant (SLPP) with four units of 125 MW capacities each is located at Village: Nani Naroli, Taluka: Mangrol, District: Surat in Gujarat. GIPCL has also operating its own captive Lignite and Lime Stone Mines close to the Power Plant. The Power Plant is based on Circulating Fluidized Bed Combustion (CFBC) technology for the Boilers, where Lignite is burnt along with Lime Stone in the Combustor of the Boiler.


It commissioned 5 MW solar power stations at SLPP in 2012. Also, GIPCL has commissioned 1MWp Distributed Solar Power Projects at two locations in Gujarat viz. at Village: Amrol, Dist.: Anand and at Village Vastan, Taluka Mangrol, and Dist.: Surat.

GIPCL has successfully commissioned a 2 X 40 MW Solar Project in 2017 as well as a 75 MW Solar Power Project in 2019 at Gujarat Solar Park, Village Charanka, Dist.: Patan. GIPCL has also successfully commissioned 112.4 MW wind farms at different location of Gujarat. GIPCL is presently executing a 100 MW Solar PV based project at the Raghnesda Solar Park, Gujarat.

Surat Lignite Power Plant (SLPP) is accessible by road from Kim and Kosamba, which are on Mumbai-Ahmedabad highway. From Kosamba, SLPP is around 32 KM, out of which 27 KM is part of the National & State Highway and balance 5 KM is District Road. From Kim, SLPP is around 18 KM, out of which 13 KM is the State Highway and balance 5 KM is District Road. The nearest Broad Gauge Railway Line is at Kim, which is around 21 KM from the SLPP. Surat is approximately 50 KM from the SLPP. Location Map for SLPP is as under:



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”. (Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

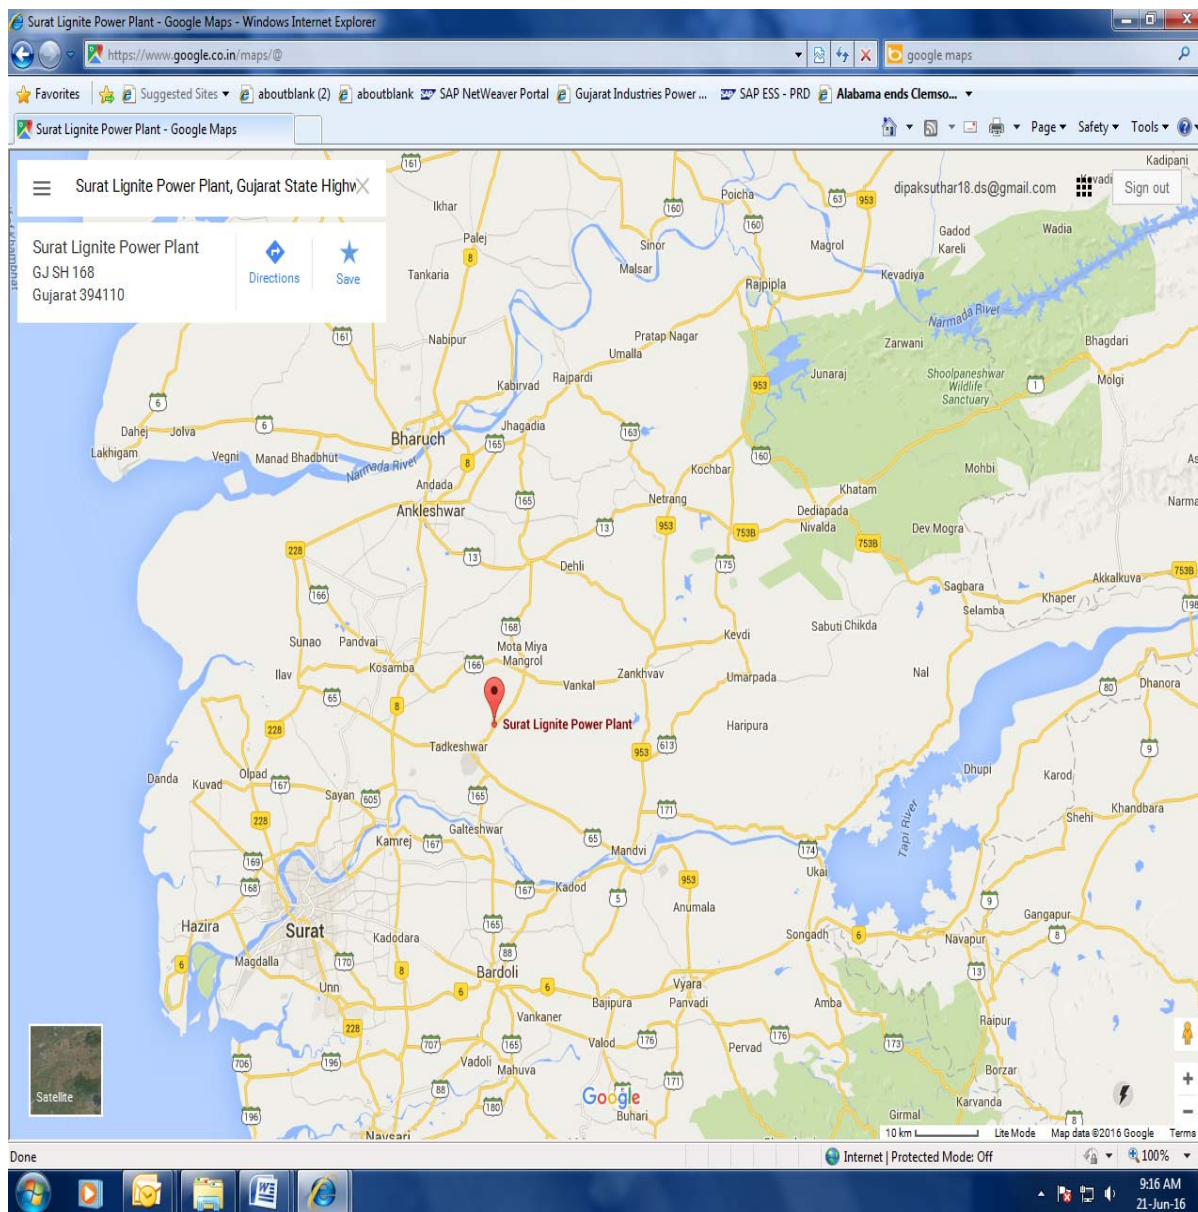

The Company intends to award Contract for Design, Engineering, Supply, Erection / Testing / Commissioning, Supervision, Performance Test of Telescopic Spout along with Proper Venting Arrangements and retrofitting with Rotary Feeder for Fly Ash Unloading Silo at, “Surat Lignite Power Plant – 4x125 MW” is therefore inviting open e-Tenders online (through GIPCL’s e-tender portal: <http://etender.gipcl.com/>) from experienced & resourceful contractors.





**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

## **2. SCOPE OF WORK:**

- 2.1** Scope of work shall be as per detailed item specifications specified in schedule of quantities and rates as per Section - E. The scope of agency shall be as follows:

### **Supply:**

This shall include the Design, Engineering, Fabrication (*relevant General Arrangement / Structural Fabrication drawings shall be submitted for GIPCL's approval*) and Supply (*including Freight charges up to GIPCL – SLPP site*) of the complete Telescopic type bulk loading Spout with inline compact filter module, Rotary Feeder, Push button control panel, allied equipments, and mandatory spares as per **Section E and Annexure-D**.

### **Erection / Testing / Commissioning at GIPCL – SLPP site :**

Deployment of Skilled Manpower by contractor for Dismantling of the old system and Erection of the complete supplied system comprising Telescopic spout, compact filter module, Rotary Feeder, Push button control panel and allied equipments including the complete required structural supports / transition pieces supplied as per the approved GA / Technical drawings.

### **Supervision / Performance / System capacity Test:**

Supervision, considering the deputation of expert representative for the successful erection, testing and commissioning, up to Performance / capacity Test for the complete supplied system. The Performance of the complete system shall have to be proved for the No visible Emission of Fly Ash Dust during closed body Truck / bulker loading for minimum Ash unloading capacity of 150 Tonnes per Hour.

- 2.2** The bid submitted by bidder not covering the total scope of work and services as detailed out in the tender document shall be liable for rejection.
- 2.3** All the miscellaneous activities pertaining to specific work to be executed for satisfactory performance is in the scope of contractor in his quoted rates.

## **3. GENERAL INSTRUCTIONS**

- 3.1** The Bidders who are interested in participating in the tender must read and comply with the instructions and the Terms & Conditions contained in the tender documents.



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

- 3.2 The Bids shall be filled in by the Bidders clearly, neatly and accurately. Any alteration, erasures or overwriting shall be liable to make the tender invalid unless the same is neatly carried out and attested over the full signature of Bidder. The decision of the Company to interpret the information and rates filled in by the Bidder shall be final and binding on the Bidder.
- 3.3 The Bidders are requested to make themselves fully conversant with the General Conditions of Contract, Technical Specifications, site conditions, safety & health aspects and norms to be observed, *bidders are also advised to conduct a site visit etc.* before submitting their bids so that no ambiguity arises in these respects subsequent to submission of the Bids.
- 3.4 Before quoting the rates, the Bidder should go through the specifications, scope of work etc. and get himself fully conversant with them. The Bid should include cost of mobilization and cost to adhere to all Safety Norms, Statutory & Legal requirements as described in the tender. No relaxation or request for revision of quoted / accepted rates shall be entertained subsequent to the opening of Bid on account of mobilization or safety costs.
- 3.5 Bidder has to submit all the information as per required Bid document. Failure to furnish all the information as per required Bid documents or submission of a Bid containing deviations from the contractual terms and conditions, specifications and requirements, shall be rejected.
- 3.6 The Bids shall be submitted within the time frames set out in the Notice inviting Tender (‘NIT’) and Bids submitted thereafter shall not be accepted and considered.
- 3.7 The tender documents shall not be transferable.
- 3.8 The Bidders are expected to examine all instructions, forms, terms & specifications in the Bid documents and to get fully acquainted themselves with all the conditions and matters which may affect the subject matter of the tender or the cost thereof. If any Bidder finds any discrepancies or omissions in the specifications and documents or any doubt in true meaning or interpretation of any part, he shall seek necessary clarifications in writing if required.
- 3.9 Conditional offers shall not be considered and liable to be rejected.
- 3.10 The Company reserves the right to extend the deadlines for submission of the Bids by giving amendments.
- 3.11 During evaluation of Bids the Company may, at its discretion ask the Bidder (s) for clarification of their Bid. The request for clarification and the response shall be in writing and no change in prices or substance of the Bid shall be sought, offered or permitted.
- 3.12 The Company reserves the right to amend/ modify the Bidding documents at any time prior to the deadline for submission of Bids, either at its own discretion or in





**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

response to the clarification requested by a prospective Bidder. In such case, the Company may in its discretion extend the deadline for submission of Bids in order to facilitate the prospective Bidders for incorporating the effect of the amendment in their Bids.

- 3.13** The Bidders shall bear all costs and expenses associated with the preparation and submission of their respective Bids, to attend meetings or conferences, if any, including any pre award discussion with the successful Bidder, technical and other presentations etc. and the Company shall not be liable for any expense thereof.
- 3.14** If the successful Bidder is consortium/ joint deed of undertaking of company, the consortium leader / bidder shall accept joint and several responsibilities and liabilities for all obligations under the Contract.
- 3.15** Timely and satisfactory completion of the work and strict adherence to the allotted time frames for jobs shall be the essence of the contract.
- 3.16** The Company reserves the right to qualify/disqualify any applicant without assigning any reason.
- 3.17** The Bidder shall be disqualified if any untrue statement or misrepresentation is made in the Bid forms, attachments and other supporting documents submitted by the Bidder.

#### **4. PLANT VISIT**

It is perquisite and necessary for all interested bidders to visit the Surat Lignite Power Plant (SLPP) after downloading the tender copy from website: <http://etender.gipcl.com> to understand the actual working conditions, compliance, safety etc. before submitting their offer. Failing which, any consequential liabilities arising will be to bidder's account.

The bidder is deemed to have examined and understood the tender document, obtained his own information in all matters whatsoever that might affect the carrying out the works expressly mentioned or works which may have to be carried out to fulfill his contractual obligation within the scheduled rates and to have satisfied himself to the sufficiency of his offer.

The submission of Tender by a Contractor implies that he has read these instructions, conditions of the contract etc. and has himself aware of the Scope, nature of works & specifications of the works to be done. General & Special terms & condition. GIPCL will not, therefore after acceptance of Contractor's rate, pay any extra charges for any other reason in case the Contractor is found later on to have misjudged the site conditions.



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

Any error in description or quantity or omission in the contract document shall not vitiate the contract or release the Contractor from executing the work comprised in the contract according to scope of works, magnitude of the works, requirement of materials, equipment, tools & tackles, labour, etc. Contractor has to complete the work in accordance with the contract documents irrespective of any defects, omissions or errors that may be found in the contract documents.

The Bidder is deemed to have examined and understood the tender document, obtained his own information in all matters whatsoever that may affect the works to be carried out especially mentioned or works which may have to be carried out to fulfill his contractual obligation within the scheduled rates and to have satisfied himself to the sufficiency for his offer.

BIDDER shall inspect the site, examine and obtain all information required and satisfy himself regarding matters such as access to site, communication, transport, working condition including constraint of work place, confined area, quantum of dusting, running equipment, importance of work, round the clock working conditions, safety requirements, temperature of fresh drained hot bed material and associated risk, right of way, high flood level in River, flow of water during monsoon/dry season in the River / Nullah, the type and number of equipment and facilities required for the satisfactory completion of work, the quantity of various items of the work, the availability of local labour, availability and rates of material, local working conditions, uncertainties of weather, obstructions and hindrances that may arise, etc which may affect the work or cost thereof, before submission of his Bid. Ignorance of site conditions shall not be accepted by the GIPCL as basis for any claim for compensation. The submission of a Bid by the BIDDER will be construed as evidence that such an examination was made. Any later claims / disputes in regard to rates quoted shall not be entertained or considered by the GIPCL.

The rates quoted by BIDDER shall be based on his own knowledge and judgment of the conditions and hazards involved and shall not be based on any representations of the Engineer.



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

## 5. ELIGIBILITY CRITERIA

The following criteria shall be adopted for qualifying the Bidders for further processing. *(Self attested copies of supporting documents must be submitted for each of following eligibility criteria).*

1. Bidder should possess minimum **Three years** of experience **during last Five years** in similar nature of work like, Design, Engineering, Manufacture, Supply, Transport, Supervision for installation & Testing, Erection and commissioning, of Telescopic spout / Bulk loading spout alongwith Proper Venting Arrangements for minimum **capacity of 80 TPH or above**, in Government Deptt. / PSU / Power Plants / Cement Plants / Steel Plants / Process Industries / Corporation / Corporate sectors / reputed private companies, and should enclose proof of the same.

Bidder shall submit necessary evidence for the same like self attested copies of Work Orders / Work Execution / Work Completion certificates from clients. The work completion certificates shall comprise of Order value & Executed value. Bidders should have executed the work directly. The work executed as a sub contractor or subletting agency shall not be taken in to consideration.

2. Bidder should produce evidence of having experience of successfully completed similar works for minimum **capacity of 80 TPH or above** as defined hereunder during last **Five years** ending last day of the month previous to the one in which tender is invited, satisfactory progress of ongoing works etc. secured from clients along with self attested copies of documentary evidence preferably photo copies of work experience. The experience should be either of the following :

- A) **One similar completed / executed work each costing not less than the amount equal to Rs. 13.34 Lakhs (without GST).**

OR

- B) **Two similar completed / executed works each costing not less than the amount equal to Rs. 8.34 Lakhs (without GST).**

OR

- C) **Three similar completed / executed works each costing not less than the amount equal to Rs. 6.67 Lakhs (without GST).**



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

Bidder should specifically mention fulfilling of above criteria in their offer along with details of work orders & work completion certificates issued by clients.

3. Bidder shall have to submit **satisfactory performance certificate** from the client. For similar nature of work like, Design, Engineering, Manufacture, Supply, Transport, installation & Testing, Erection and commissioning of Telescopic spout / Bulk loading spout alongwith Proper Venting Arrangements for minimum **capacity of 80 TPH or above**, in Government Deptt. / PSU / Power Plants / Cement Plants / Steel Plants / Process Industries / Corporation / Corporate sectors / reputed private companies, for a period of not less than one year from the date of commissioning as on opening of tender.
4. Bidder shall have individually, successfully executed minimum three nos. of work orders for similar nature of work like, Design, Engineering, Manufacture, supply, transport, supervision, installation and commissioning etc. for minimum **capacity of 80 TPH or above**. Experience as a sub-contractor will not be allowed and Price Bid of such Bidders will be liable for rejection.
5. Only those bidders who have supplied and commissioned Telescopic type bulk loading spouts for Cement / Fly Ash of **capacity 80 TPH or above** and are working satisfactorily for at least one year after commissioning are eligible to quote. Information about the companies where same or higher size equipments have been supplied and certificate about satisfactory performance are to be submitted for qualification of the offer.
6. Bidder should have average annual turnover of **Rs. 5 Lakh (without GST)** for last three financial years (2017-18, 2018-19 & 2019-20). Bidder shall furnish annual audited financial statement duly certified by Chartered Accountant for the last three financial years to demonstrate the financial healthiness of the company. The balance sheet and Profit and Loss Account must be in the name of the company. Any type of MOU for this purpose will not be entertained.

**Note:** In case, the annual turnover is less than the statutory guideline which does not require audit, the bidder shall submit the turnover certificate from Chartered Accountant.

7. **Tender Fee:** The tender fee, shall be accompanied in form of Demand draft / RTGS or through online payment as per details provided in clause no. 8 herein under.
8. **EMD:** The EMD shall be in the form of DD / RTGS or Bank Guarantee given by Bank as described in subsequent clause no. 8.



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

9. Bidder should have separate Employees Provident Fund code number towards registration of firm with RPF commissioner.
10. The Bidder has to submit INCOME TAX Permanent Account Number (PAN), TIN / GST registration number, Copies of the same shall be submitted.
11. The net worth of the bidder should be positive as evidenced from audited accounts of last financial year.
12. In case bidder is consortium / Joint deed of undertaking of company, the above requirements / credentials of consortium leader / bidder shall be considered unless otherwise specifically mentioned in the tender.
13. If Bidder or its Partner(s) or Director(s) is / are / was Black listed / Deregistered / stopped or banned from dealing in the past by any Govt. of Gujarat Undertakings / Depts. / Authorities and Govt. of Gujarat supported companies / undertakings / organizations, Bid of that party will be liable to be rejected. Bidder agrees and undertakes to accept decision of GIPCL in this regards as final and binding on the Bidder without any demur and that no further correspondence shall be done in this regard at any stage. Bidder shall have to submit the “Declaration for Contractual Disputes / Litigations” as appended in Annexure / Form attached.
14. Bidder shall have to submit the “Declaration-cum-undertaking for compliance of safety Law and Regulations” as per amended in Annexure / Form attached.
  - If any Fatal Accident / Violation of any safety law(s) / Rule(s) is / are found during the preceding Three (3) years, Bid of that party will be liable to be rejected. Bidder agrees and undertakes to accept decision of GIPCL in this regards as final and binding on the Bidder without any demur and that no further correspondence shall be done in this regard at any stage.
  - If any of the details submitted in the prescribed Annexure / Form to the Bid is/are found to be false, incorrect at any time in future, then the Contract awarded to that Bidder / Contractor shall be liable to be terminated forthwith without any notice / correspondence and Bidder agrees and undertakes to accept decision of GIPCL in this regards as final and binding on the Bidder without any demur and that no further correspondence shall be done in this regard at any stage. Further, Performance / Security Deposit will also be liable to be forfeited. Any dues to GIPCL from the Bidder / Contractor shall be recovered from the pending bills or any other dues payable to the Bidder / Contractor, if any or otherwise through any other recourse available under the Laws.

The Bidder shall submit all the evidences, documents, attested copies of work orders & work completion certificates etc. as a proof with EMD and Tender fee and also provide the requisite details online for meeting the prequalification



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

requirements. GIPCL will verify the experience, performance, capability & strength of Bidders, independently for executing the job. GIPCL may visit the site & consult the owner of the industry / property where similar job is executed by the Bidder. GIPCL reserves the right to accept / cancel / reject any / all Bids without assigning any reason thereof. The tenders of qualified Bidder / Bidders shall only be considered for further evaluation.

## **NOTE**

- I.** Bidder should specifically mention fulfilling of above criteria in his offer along with details of work orders & work completion certificates issued by clients.
- II.** As delivery period is the essence of the tender, bidder should accept the delivery period mentioned in the Tender. Otherwise, offer will not be considered.
- III.** Other Documents which are to be submitted i.e.
  - A.** Bidder shall submit the drawing and documents.
  - B.** Bidder shall submit GA with dimensioned drawing of Telescopic spout, venting arrangements, Rotary Feeder and allied equipments.
  - C.** Bidder shall submit electrical & Instrumentation arrangement, drawings as applicable.
  - D.** Bidder shall submit catalogues, data sheet.
  - E.** Bidder shall submit operation and maintenance manual.
  - F.** Bidder shall submit the Operation Philosophy.
- IV.** Vendors are advised to carry site visit prior to submission of bid to understand the scope of work, working conditions, site conditions, equipments, tool & tackles, labour deployment, associated risk, surrounding etc.

It is necessary to carry out site visit to understood in detail regarding actual working conditions, scope of work with respect to estimated requirements of manpower, supervisors, materials, transport vehicles, tools & tackles, height of structures & buildings, available approaches, safe working conditions, work permit system, gate pass system statutory & legal requirements, special requirements, to understand, resource & equipment requirements, approaches, plant O&M requirements, etc. Site visit may be carried out before submission of bid with prior intimation to GIPCL.





**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

**It is also desirable to study tender documents thoroughly before site visit. Also, considering prevailing nationwide COVID-19 epidemic, site visit will be carried out with advance intimation subject to following;**

- 1) Only site visit will be arranged preferably for any 01 or maximum up to two authorized persons having valid authorization letter/s during site visit considering present scenario of COVID-19 epidemic.
- 2) Details of visiting person/s like Name, age, designation, address, recent medical history (preferably for previous 01 month), recent travel history (for previous two weeks), etc... should be provided to GIPCL in advance through email.
- 3) Address proof of visiting person/s is required during site visit. If person/s coming from containment zone, same will not be allowed.
- 4) Wearing of facemask is compulsory for visiting person/s during the site visit.
- 5) Visiting person/s should follow applicable prevailing guidelines/travel advisory of Gol / GoG regarding COVID-19 epidemic.
- 6) Visiting person/s should cooperate with GIPCL security staff, HR&A department & employees regarding any further instructions to be followed on COVID-19 epidemic during site visit.
- 7) “Aarogya Setu” mobile application should be available updated.

## **6. LANGUAGE OF BID**

The Bid prepared by the Bidder, and all correspondence and documents relating to the Bid exchanged by the Bidder and the Company, shall be written in the English language. Any printed literature furnished by the Bidder, written in another language shall be accompanied by an English translation for the purpose of interpretation of the Bid.

## **7. EARNEST MONEY DEPOSIT (EMD) AND TENDER FEE**

- 7.1 An EMD of Rs. 17,000/- and Nonrefundable Tender fee Rs. 2950/- shall accompany with Bid. Tender fee shall be submitted through RTGS / in the form of a crossed bank Demand Draft in favour of Gujarat Industries Power Co. Ltd. only.
- 7.2 The EMD shall be submitted in the form of DD / irrevocable Bank Guarantee (BG) in favour of Gujarat Industries Power Company Limited from any schedule Public



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

Sector Bank or Schedule Private Sector Bank as per Performa of BG enclosed with this e-tender.

**Bank for EMD DD**

1. State Bank of India

**Payable at:**

Nani Naroli, Branch Code: 13423

Alternatively, the EMD & Tender Fee may also be submitted through RTGS / online mode of payment by the bidder as per following details for which RTGS transaction charges (if any) shall be borne by the bidder:

**RTGS Detail:**

1. Name of account holder: Gujarat Industries Power Co. Ltd.
2. A/c. No.: 33514692834
3. Name of Bank : State Bank of India
4. Bank address: Utility Building, Nani Naroli, Ta. Mangrol, Dist. Surat. Pin 394110.
5. IFSC code : SBIN0013423
6. MICR code : 394002513

**EMD & Tender fee may also be submitted through online payment gateway of company's website: <http://www.gipcl.com> (online Payment Form) as per detail provided in this tender.**

- 7.3** The EMD, in alternative, may be submitted in the form of irrevocable Bank Guarantee in favour of Gujarat Industries Power Company Limited from any Nationalized Bank including Public Sector bank - IDBI Ltd or AXIS Bank, HDFC Bank, ICICI Bank or Kotak Mahindra bank, Ratnakar Bank, IndusInd Bank, Karur Vysya Bank, DCB Bank, ING Vysya Bank or The Kalupur Commercial Co-operative Bank Ltd, Rajkot Nagrik Sahakari Bank Ltd, The Ahmedabad Mercantile Co-operative bank Ltd, The Mehsana Urban Co-operative Bank Ltd, Nutan Nagrik Sahakari Bank Ltd as per Performa of BG enclosed with this E-tender under Section-F.
- 7.4** In case EMD is paid in the form of BG, the same shall be valid for a period of 180 days after the due date for submission of the Bid.
- 7.5** The EMD of the successful Bidder will be returned after payment of Security Deposit by successful Bidder.
- 7.6** The Earnest Money Deposit will be refunded to the unsuccessful BIDDER as soon as the Tender is finalized and after award of LOI / Work Order.



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

- 7.7 Any bid not accompanied with EMD and Tender fee will be rejected. Tender fees and EMD should be submitted to GIPCL.
- 7.8 No interest shall be payable on EMD.
- 7.9 The EMD will be forfeited if the BIDDER (i) withdraws his Tender after acceptance or (ii) withdraws his Tender before the validity date of the tender.
- 7.10 **SCHEDULE OF EMD & TENDER FEES :**

EMD & Tender Fee and other documents duly signed to be submitted in physical form, on or before due date of closing of the Tender.	Address for Submission: <b>General Manager (SLPP)</b> <b>GUJARAT INDUSTRIES POWER CO.LTD.</b> <b>(Surat Lignite Power Plant)</b> <b>Village : Nani Naroli, Taluka : Mangrol,</b> <b>District :Surat 394 110, Gujarat,</b> <b>Phone : 02629-261063</b> <b>Fax : (02629) 261073 / 261074</b>
--	---

## 8. SUBMISSION OF BIDS

### A. MODE OF SUBMISSION

The Bids shall be submitted online on GIPCL's E-Tender portal: <http://etender.gipcl.com/> within the dates specified in the NIT along with the details of Tender fees, EMD in two parts as under:

- (a) Pre-qualification and Techno-commercial Bid without price.
- (b) Price Bid.

#### a) **Pre-Qualification and Techno-commercial Bid without price:**

The Tender Document duly signed in all pages without price bid along with techno-commercial deviations, if any, shall accompany the bid, the following Information shall be provided in the techno commercial bid:

1. Qualification and experience of Site-in-charge.



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”. (Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

2. Schedule of deviation (Annexure-I) Technical as well as commercial, if any.
3. Qualification & experience of Supervisors / Engineers.
4. List of available equipments, tools & tackles which are required to perform the scope of works as specified in this tender.

The following supporting documents shall also be submitted along with EMD & Tender Fee in physical form or scanned copies through provided email address:

1. The Tender Document duly signed in all pages without price bid along with Techno-commercial deviations, if any.
2. Proof of experience meeting the minimum ‘Eligibility Criteria’ as mentioned in tender document.
3. Performance certificate issued by clients.
4. Previous Work Order copies.
5. Details of present Work Order (if any).
6. Turn over for the last three years, audited annual accounts / financial statements i.e. profit and loss account and balance sheet duly certified by a practicing CA will be required.
7. PF Number and Allotment Letter.
8. PAN Number.
9. Goods & Service tax (GST) registration number / certificate copy.

**b) Price Bid:**

1. Price Bid shall be submitted **only** in soft form through GIPCL’s E-Tender portal: <http://etender.gipcl.com>

**Note: Estimate includes cost of all manpower, Supervision, approved quality materials, equipments, vehicles, consumables, fuel, spares, maintenance, mobilization-demobilization, tools & tackles, scaffolding materials, transportation, all site safety arrangements with approved safety equipments, standard safety PPEs, safety & statutory compliance, all taxes & duties (other than GST).**

2. Goods & Service tax shall be paid extra at actual as per prevailing rates as declared by central Government on submission of documentary evidence.
3. Rates will remain firm throughout the contract period and any extension thereof. There will not be any escalation / compensation to the contractor against any revision and / or change in rate of materials, fuels, MWR (Minimum Wage Rates), etc... whatsoever.



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

4. The Bidder shall fill the Bid documents with utmost care in consonance with the instructions contained in the Bid documents.

## **B. METHOD OF TENDERING / SIGNATURE ON BIDS**

- (i) The Bid must contain the postal address like name, residence and place of business of the person or persons submitting the Bid and must be signed and sealed by the Bidder with his usual signature. The name of all persons signing the documents shall also be typed or printed below the signature on each page.
- (ii) Bid by a consortium / joint deed of undertaking of company / partnership firm must be with full names of all partners and be signed with the partnership name, followed by the signature and designation of one of the authorized partners or other authorized representative(s). A certified copy of the power of attorney authorizing such partner or representative shall also be submitted.
- (iii) Bids by a Corporation / Company must be signed with the legal name of the Corporation / Company i.e. by the President / Managing Director / Secretary or other person or persons authorized to Bid on behalf of such Corporation / Company. A certified copy of the board resolution / power of attorney authorizing such partner or representative shall also be submitted.
- (iv) The Bidder's name stated on the proposal shall be the exact legal name of the firm.
- (v) Erasures or other changes in the Bid Documents shall be initialed by the person signing the Bid.
- (vi) Bids not conforming to the above requirements of signing shall be disqualified.

## **9. MODIFICATION AND WITHDRAWAL OF BIDS**

- a. The Bidder may modify or withdraw the bid prior to the deadline prescribed for submission of bids.
- b. No Bid shall be modified subsequent to the deadline for submission of Bids.
- c. No Bid shall be withdrawn in the interval between the deadline for submission of Bids and the expiration of the period of bid validity.

## **10. POLICY FOR BIDS UNDER CONSIDERATION**

- a. Bid shall be deemed to be under consideration immediately after opening of the bid and till official intimation of award / rejection made by the Company to the Bidders.
- b. While the Bids are under consideration, Bidders and / or their representative or other interested parties are advised to refrain from contacting by any means, the



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

Company. The Engineer, if necessary, will obtain clarifications on the Bids by requesting for such information from any or all the Bidders, in writing as may be necessary. The Bidder will not be permitted to change the price or substance of the Bid after the Bid has been opened.

## **11. EFFECT AND VALIDITY OF BID**

- a. The Bid should be kept valid for acceptance for a period of one hundred and eighty (180) calendar days from the last date of submission of Bids.
- b. The submission of any Bid along with the required documents and specifications shall constitute an agreement that the Bidder shall have no cause of action or claim, against the Company for rejection of his Bid. The Company shall always be at liberty to reject or accept any Bid or Bids at his sole discretion and any action will not be called into question and the Bidder shall have no claim in that regard against the GIPCL.

## **12. OPENING OF BIDS**

**12.1** The GIPCL will open the pre-qualification / Technical Bid / price Bid, as the case may be, in presence of Bidder's representatives whenever such a procedure has been specified. Otherwise the tender will be opened by the authorized officers of GIPCL.

### **12.2 Preliminary Examination:**

**12.2.1** The Company will examine the Bids for any computational errors, for sureties furnished by bidder, for authentication of documents submitted and completeness of the Bids.

**12.2.2** Arithmetical errors will be rectified on the following basis:

- (a) If there is a discrepancy between the unit price and the total price that is obtained by multiplying the unit price and quantity, the unit price shall prevail and the total price will be corrected & will be binding to the bidders.
- (b) If there is a discrepancy between the Total Bid Amount and the sum of total prices, the sum of total prices shall prevail and the Total Bid Amount will be corrected & will be binding to the bidders.





**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

### **13. EVALUATION & COMPARISON OF BIDS**

- 13.1** GIPCL shall evaluate the Bids received and accepted by it to ascertain the lowest evaluated Bid in conformity with the specifications of the tender documents.
- 13.2** The Technical Bids will be examined for minor matters regarding qualification of bids. Subsequent to correspondence with the respective bidders, the decision of Tender Committee will be final.
- 13.3** All responses to requests for clarifications shall be in writing and shall be presented to the Company through e-mail or in a sealed envelope on or before the given date requested by the Company. If the Technical clarifications sought by the Company do not reach the Company on or before due date, the Bid will be rejected.
- 13.4** The comparison of all the Bids shall be carried out with reference to the scope of work as per the technical specification. Any deviation / omission shall be evaluated at highest quoted price of the deviation / omission quoted by any of the Bidder. In case a separate price (for omission) is not given by any other Bidder, a reasonable price of the same shall be taken & the same shall be binding to the Bidders.
- 13.5** The commercial deviation, if any, shall be loaded to bring all the Bids at par. The loading shall be carried out at an interest rate of 2% above PLR of SBI.
- 13.6** A Bid to be substantially responsive shall be one which on evaluation confirms to all the terms, conditions and specifications of the Bid documents without any material deviation or reservation.
- 13.7** For the above referred purpose, a ‘material deviation’ shall be one which:
  - (a) Which affects in any substantial way the scope, quality or performance of the contract, or
  - (b) Which limits in any substantial way and in a manner inconsistent with the Bid documents, GIPCL’s right or the Bidder’s obligations, under the contract, or
  - (c) Whose rectification would affect unfairly the competitive position of other Bidders presenting substantially responsive Bids.

### **14. RIGHT OF REJECTION OF TENDERS**

- 14.1** GIPCL reserves the right to accept or reject any Bid or to cancel the Bidding process and reject all Bids at any time prior to award of contract, without thereby incurring any liability to the affected Bidder or Bidders or any obligation to inform the affected Bidder or Bidders regarding the same.



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

- 14.2** Any Tender without EMD and Tender fee will be treated as non responsive and shall be rejected at the outset & no further correspondence shall be entertained regarding this.
- 14.3** GIPCL reserves the right to debar any Bidder from participation in future Bids if such Bidder has quoted an abnormally low rate in the Bid document / price Bid.

## **15. AWARD OF CONTRACT**

- 15.1** GIPCL will award the contract to that bidder whose quotation has been determined to be substantially responsive and evaluated as the lowest quotation in conformity with the requirements of the specifications and documents contained herein, provided further that the bidder is determined and evaluated to be qualified to perform the contract satisfactorily.
- 15.2** The successful bidder shall be intimated of his selection through the Letter of Intent or Letter of Award / Work Order which shall be sent to him through e-mail, courier, fax or registered mail.
- 15.3** GIPCL reserves the right to split the contract quantity between vendors.

## **16. CONTRACT PERIOD**

- 16.1** The contract will be for a period of 12 (Twelve) months from the date of LOI or Work Order, which is earlier.
- 16.2** GIPCL reserves the right to extend the contract period up to 3 months on the same rates, terms and conditions without any price escalation and without entering into any new contract.
- 16.3** The said contract period can be extended if mutually agreed upon by both the parties up to one year and in such case a revised work order shall be issued at the same rates and terms & condition or at negotiated rates acceptable by both parties i.e. Company & the contractor.

## **17 ASSIGNMENT AND SUB-LETTING**

The Supplier shall not directly or indirectly assign or sub-let total/any part of the contract to any other party or agency.

## **18 CONTRACTOR'S OBLIGATIONS**

### **A: DEPLOYMENT & RESPONSIBILITY OF MANPOWER**

- (i) The Contractor shall deploy suitably qualified and sufficient manpower for timely & satisfactorily execution of the works under the contract.



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

- (ii) The Contractor shall deploy sufficient skilled, Semi-skilled and Un-skilled manpower separately to properly complete the job in given / scheduled time.
- (iii) The Contractor shall depute its own workmen / labor with proper identification to enter the plant premises after ensuring that the jobs are scheduled.
- (iv) At the time of deploying manpower, the Contractor shall strictly comply all the applicable labor laws / Acts norms including but not restricted to the age of the workers, women workers and shall also ensure that a police verification, security check, for all the workmen / labor engaged at the GIPCL site is done and necessary documents regarding the same shall be submitted to the GIPCL's authorized representative / officer-in-charge. Any default in complying with the same or any misrepresentation regarding compliance of the same shall compel GIPCL to initiate appropriate civil or criminal proceedings regarding the same.
- (v) The Contractor shall also comply with the safety requirements and provide his workmen / labor with safety equipments like safety helmets, masks, gum boots, safety shoes, hand gloves, a uniform and other necessary PPEs for properly undertaking the operations involved under this contract. Following are also to be issued by the contractor:
  - a) Safety shoes (standard approved ISI make)
  - b) Safety helmet (standard approved ISI make in yellow colour only)
  - c) Safety Goggles / face shield.
  - d) Ear plug / Ear muff.
  - e) Hand gloves like electrical hand gloves / cotton hand gloves / Chemical hand gloves.
  - f) Full body double harness Safety belt. (as per requirement of the job)
- (vi) Contractor shall nominate / authorize senior experienced person in writing as site-in-charge to co-ordinate with GIPCL engineer and who shall bear overall responsibility for performance of the contract. Such person shall remain always available at site or site office allotted to the contractor at SLPP site. Contractor has to submit the authority letter and documentary proof for the same.
- (vii) The Contractor shall appoint a supervisors who shall co-ordinate with GIPCL's Engineer-In-Charge for daily entrusted job. They have to maintain daily records dully signed for the works carried out and duly certified by Engineer-In-Charge. The Contractor in co-ordination with the Engineer-In-Charge shall ensure the availability of adequate manpower to carry out the job satisfactorily on a daily basis. As per the instruction of Engineer-In-Charge they have to allot the work and execute the same in specified time limit.



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

- (viii) During execution of the works, one or more jobs may be required to be done simultaneously and the Contractor shall mobilize additional resources accordingly.
- (ix) During emergency or similar situations the Contractor shall be required to mobilize resources as per need within the period of 24 hours as directed by GIPCL. If the contractor fails to mobilize sufficient manpower to complete the job in time, GIPCL will execute the job through other agency at the risk and cost of the contractor with 10% supervision charges & the same will be recovered from the Contractor's bill .
- (x) **Important Note: Whenever any of the Unit at SLPP remains under outage due to any reason and require emergency work, the contractor shall mobilize sufficient work force at site within a period of twenty four hours from the time of intimation to the site-in-charge or via mail to your office. Generation loss occurred due to want of manpower as well as resources will b viewed very seriously and will invite appropriate punitive measures as decided by competent authority.**
- (xi) During working in high risk area like hot lines of steam / water / oil, the workman must wear a suitable safety apron, safety belt, safety hand gloves & goggles. It is the contractor's / contractor's supervisor's responsibilities to ensure it without fail.
- (xii) During unit overhauling, the contractor has to enhance the site manpower as per the requirement to ensure the timely completion of work (During overhauling period quantum of work increases substantially). For this, enhanced work shall be completed by deploying additional manpower with separate supervisor. Payment will be made on item rate basis only. The work during the overhauling period is to be carried out round the clock. Contractor should mobilize sufficient number of manpower and execute the work in all shifts with independent manpower. Contractor should not continue the same manpower for more than 12 hours.

#### **B. TOOLS & TACKLES:**

- (i) All tools & tackles and equipments required to execute the contract are in the scope of the contractor. The contractor should ensure that tools & tackles are in healthy & working condition. All consumable items would be in the scope of the contractor  
**(Note: If work is suffered due to want of sufficient manpower, tools & tackles, vehicles, equipments and / or required consumables / materials then 25% of the total job cost will be levied as a penalty for each and every instance).**



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at "Surat Lignite Power Plant – 4x125 MW".(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

- (ii) For proper execution of the work as per the scope, the contractor is required to maintain sufficient quantity of tools & tackles, equipments, scaffolding materials in good working condition at site as per day to day work load and emergency situations to complete the work in stipulated time.
- (iii) In case of breakdown of equipment, the contractor should work round the clock for putting back the area in service immediately within minimum time. In case of any emergency arising during night hours the contractor should be in a position to mobilize the manpower immediately within minimum time.
- (iv) Arrangement for lighting at the work spot has to be made by the contractor. He has to arrange all lighting equipment such as power cable, hand lamps. The contractor has to take prior approval for taking electrical power supply. The contractor should keep hand lamps of 24Volt for confined space and sufficient quantity of 240 Volt halogen lamp for other area ensuring safety at work place.
- (v) Pin sockets of IS standards should be used for all connections. For any accident take place & any damage to the equipment and / or injury to human due to carelessness in loose connection, contractors will be held responsible & liable for any recovery/actions.

## **19 CLARIFICATION OF BIDDING DOCUMENTS**

If any Bidder requires any further information or clarification in the Bidding Documents, may notify the Company before one week of last date of submission of online Bid, in writing or by E-mail at the GIPCL's mailing address [opsharma@gipcl.com](mailto:opsharma@gipcl.com) as indicated in the 'Invitation to Bids'. The GIPCL's response (including an explanation of the query) will be sent in writing or by E-mail to all prospective Bidders who have received the Bidding Documents.

## **20 TIME SCHEDULE**

The basic considerations and the essence of the 'Contract' shall be the strict adherence to the time schedule for performing the specified 'Works'.

## **21 UNDERSTANDING AND CLARIFICATION ON DOCUMENTS AND SPECIFICATIONS**



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

The Bidder is required to carefully examine the specifications and documents, all the conditions and matters work wise & cost wise. If any Bidder finds any discrepancies or omissions in the specifications and documents or is in doubt for any meaning of any part, he shall request in writing for an interpretation/ clarification to the GIPCL.

All such interpretations and clarifications shall form a part of the Bid documents.

## **22 PAYMENTS**

All the payments against the work order shall be in Indian currency and payable through cheque / RTGS (online payment) only.

## **23 POINTS TO BE CONSIDERED DURING QUOTING ONLINE PRICE BID**

- a. The schedule of rates shall be read in conjunction with Instructions to Bidders, General conditions of contract, Special conditions of contract and Technical specifications.
- b. The quantities given in the schedule of rates are estimated and payment will be made as per actual work carried out as per the rates of work order.
- c. The method of measurement of completed work for payment shall be in accordance with the method of measurement specified in the tender.
- d. No separate amount shall be payable for use of auxiliary equipment incidental to or in day to day operation in the course of fulfillment of contractual obligation of the vendor/contractor.

**Note: Interested bidders are requested to submit the online tender offer at least two days in advance from the due date set for online submission of bid in order to avoid non participation of e-tender due to probable technical problem in e-tender system / server.**

## **24 QUANTITIES**

The quantities specified are estimated and for tendering purpose only. Payment will be made, based on actual work done as certified by Engineer-in-charge of GIPCL.

Quantities of individual items may be revised during the course of contract period based on site requirement. Contractor shall not be entitled for any compensation on ground of such alteration in scope of work. GIPCL reserves the right to operate or increase / decrease quantities in each item or omit any item included in Schedule of





**Tender Document for** : Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

Quantity at his discretion. Contractor shall have no claim, whatsoever, on grounds of loss of anticipated profit etc. on account of the same.

After commencement of the work, GIPCL, for any reason may not require to be carried out the whole / part of the work as specified in the tender, the ENGINEER-in-charge shall inform the fact for thereof to the CONTRACTOR and contractor shall have no claim for any payment or compensation whatsoever on account of any profit or advantage which he might have derived from the execution of the work in full but which he did not derive in consequence of the full amount of the work not having been carried out nor shall he have any claim for compensation by reason of any change having been made in the original specifications and instructions which shall involve any curtailment of the work as originally contemplated.

\*\*\*\*\*



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

## **SECTION-B**

### **INSTRUCTIONS TO BIDDERS FOR ONLINE TENDERING**

1. Tender documents are available only in electronic format which Bidders can download free of cost from the website - <http://etender.gipcl.com/>.
2. All bids (technical and price bid) should be submitted online through the website <http://etender.gipcl.com/> only. No physical submission of price and technical bid will be entertained as it should be furnished online only. Also no fax, e-mail, letters will be entertained for the same.
3. Following should be submitted ‘off-line’ in sealed covers separately during dates & time set in NIT at our office at Village: Nani Naroli, Taluka: Mangrol, Dist.: Surat - 394 110, Gujarat.
4. **[1] Tender Fee, [2] E.M.D. covers, [3] Supporting Documents for Technical Bid.**
5. First time Bidders who wish to participate in online tenders through GIPCL's e-tender portal will have to register their firm at GIPCL-SLPP through vendor registration option available in the website: <http://etender.gipcl.com/> at least before five working days from due date set for online bid participation. GIPCL will not be held responsible in case of late submission for vendor registration. Bidders shall fill the online vendor registration form and submit it online. GIPCL will create vendor code which will be used as user ID for online participation in GIPCL's tenders. Both vendor code (user ID) and password will be generated automatically and will be sent by auto generated e-mail to bidder's official e-mail accounts as provided by bidder in vendor registration form.
6. Interested bidders are requested to submit the online tender at least two days in advance from the due date set for online submission of bid in order to avoid non participation.

\*\*\*\*\*



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

## **SECTION-C**

### **GENERAL CONDITIONS OF CONTRACT**

#### **1) CONTRACT SECURITY DEPOSIT / PERFORMANCE BANK GUARANTEE**

As a Contract Security / Performance Bank Guarantee, the successful Bidder, to whom the work is awarded, shall be required to furnish a Performance Bank Guarantee (PBG) / Contract Security Deposit (SD) in favour of Gujarat Industries Power Company Limited of an equivalent amount of Ten percent **(10%)** of the “Total Contract Price excluding taxes & duties” from any Scheduled Public sector Bank OR Scheduled Private Sector Bank in the format attached in **SECTION-F**, and it shall guarantee the faithful performance of the 'Contract' in accordance with the terms and conditions specified in these documents and specifications. Contract security deposit / PBG shall be submitted strictly within twenty one (21) days from the date of Lol or work order, whichever is earlier. The PBG / SD shall be valid till the **defect liability period as specified in Clause No. 7 of Section D** – special conditions of contract. The Guarantee amount shall be payable to the Company in Bidder's home currency without any condition whatsoever.

GIPCL reserves the right to forfeit performance Bank Guarantee (PBG) ./ Contract security deposit

The Performance Bank Guarantee (Initial Security deposit) shall be returned to the Vendor / Contractor without any interest after the completion of 'defect liability period' after the completion of Contract and on fulfilling contractual obligations throughout the retention period. However, any delay in submission of SD will result in equivalent late release of entire SD after guarantee period.

Bid security / EMD should be refunded to the successful bidder on receipt of Performance security.

#### **2) RECOVERY CLAUSE**

- (i) In case of any damage of equipment / machinery due to negligence of contractor or any other reasons attributed to contractor the decision of Engineer-in-charge regarding the amount of recovery shall be final and binding subject to a maximum of 10% of contract value. Recovery will be affected from the monthly bills and / or retention money / security deposit.



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

- (ii) If the contractor fails to execute the work as per directions of Engineer (I/c) within the time frame given in work order and as per day to day instructions by Engineer-in-charge, GIPCL shall get the work done by third party at the risk & cost of the contractor with 10% additional overhead charges of GIPCL.

### **3) DEDUCTIONS FROM CONTRACT PRICE**

All costs, charges or expenses that GIPCL may have paid, for which, under the contract the contractor is liable, shall be recovered by the GIPCL. The contractor shall pay all such claims within 15 days of claim, failing which the same shall be deducted from the bills of contractor.

### **4) TERMINATION OF CONTRACT BY GIPCL**

Contractor shall be responsible to complete the jobs within agreed time schedule and in case contractor fail to complete the job, GIPCL shall recover from his bill, Security Deposit and / or whatsoever for expenses incurred to complete the job with additional 15% overhead charges.

In case if contractor's services are not found satisfactory with respect to mobilization, time bound activities, workmanship & safety (OHSAS policy of GIPCL) then GIPCL has right to terminate the contract at any time by giving him 15 days advance notice without assigning any reason and will make the alternate arrangement at the risk & cost of contractor. GIPCL may terminate the contract after due recoveries of pending jobs / damages after giving 15 days advance notice to the contractor if any of the following events occur –

- I. Contractor is adjudged as insolvent.
- II. Contractor has abandoned the contract.
- III. Contractor fails to proceed with the work with due diligence as per requirements of the contract.
- IV. Contractor has neglected or failed persistently to observe or perform any of the acts, matters or things, which as per the contract are to be observed and performed by the contractor.
- V. Contractor repetitively violating the safety norms for more than three incidents.
- VI. Any major contradiction of applicable labour laws.
- VII. Any major deviations from contractual terms and conditions including quality of job.
- VIII. GIPCL reserves the right to terminate the contract without giving any reason whatsoever and forfeit the PBG.



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

## **5) FAILURE & TERMINATION**

If the CONTRACTOR after receipt of written notice from the GIPCL / ENGINEER requiring compliance, with such further drawings and / or the GIPCL / ENGINEER instructions fails within seven days to comply with the same, the GIPCL / ENGINEER may employ and pay other agencies to execute any such work whatsoever as may be necessary to give effect thereto and all costs incurred in connection therewith shall be recoverable from the CONTRACTOR by the GIPCL on a certificate by the GIPCL / ENGINEER as a debt or may be deducted by him from any money due or to become due to the CONTRACTOR.

If the contractor fails to execute the work or fails to mobilize the resources and as per directions of GIPCL / ENGINEER within the time frame given and / or violating the GIPCL's safety rules & regulations, ENGINEER / GIPCL shall get the work done by third party at the risk & cost of the CONTRACTOR with additional 10% overhead charges of GIPCL and all costs incurred in connection therewith shall be recoverable from the CONTRACTOR by the GIPCL /ENGINEER as a debt or may be deducted by him from any money due or to become due to the CONTRACTOR.

## **6) SETTLEMENT OF DISPUTES**

- a. Any disputes or difference of opinion between parties arising out of the contract to the extent possible shall be settled amicably between the parties. If amicable settlement cannot be reached all the disputed issues shall be resolved through arbitration before a Sole Arbitrator appointed by Managing Director, GIPCL according to the provisions of The Arbitration & Conciliation Act, 1996. As amended from time to time. The place of arbitration shall be at Vadodara / Surat or any other place within state of Gujarat.
- b. Work under the contract shall be continued by the contractor during arbitration proceedings unless GIPCL shall order suspension thereof or any part thereof in writing or unless the matter in such work cannot possibly be continued unless the decision of the Arbitration proceedings is obtained.

## **7) INTERPRETATION OF CLAUSE**

In case of disputes as regards interpretation of any of the clauses or specification, the decision of Head of Management (HOM) - GIPCL will be final and binding on the contractor.



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

## **8) EMPLOYEE'S COMPENSATION INSURANCE**

Contractor shall take all risk Insurance Policy to cover all his workmen / employees, staff applicable under the Employee Compensation Act 1923 or any amendment thereof as also insurance cover for third party liability.

The contractor shall keep the GIPCL indemnified from all liabilities arising out of his action in pursuance of this contract. The E. C. Policy should be obtained from Surat Jurisdiction and shall be assigned to GIPCL. EC policy should cover the specified contract period.

Contractor shall also obtain additional off-duty coverage insurance policy for all his workers.

## **9) STATUORY REQUIREMENTS**

### **A. COMPLIANCE OF LABOUR LAWS**

The contractor shall at his own cost comply with the provision of labor laws, rules, orders and notifications whether central or state or local as applicable to him or to this contract from time to time. These Acts / Rules include without limitation of the followings.

1. Contractor shall be solely responsible and shall fully comply with all the provisions of all the labor laws applicable such as the Minimum Wages Act, 1948, Contract Labor (Regulation & Abolition) Act 1970, Factories Act, 1948, Payment of Bonus Act 1965, Employees Provident Fund and Miscellaneous Provision Act 1952, Industrial Dispute Act 1947, Workmen Compensation Act 1923, Payment of Gratuity 1972, Interstate Migrant Workmen Act 1979, Equal Remuneration Act with Rules, Order and Notifications issued / made there under from time to time.
2. All other Acts, Rules / Bye-Laws, Orders, Notifications etc. present of future applicable to the contractor from time to time for performing the contract job.
- 2.1 The Contractor shall provide and be responsible for payment of Wages, Salaries, Bonus, Social charges, Insurance, Food, Accommodation, Transport, Medical and Canteen facilities and other statutory privileges and facilities to his personnel as per law / rules / regulations and orders of the Central Government, State Government, Local Authorities or other authorities as are in





**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

force from time to time. All employees of the Contractor shall be employee of the Contractor.

- 2.2 The contractor shall have a valid license obtained from Licensing Authority under the Contract Labor (Regulation & Abolition) Act-1970 at the time of execution of the contract covering all his employees working at SLPP site and furnish the same failing which GIPCL may terminate the contract at its sole discretion.
- 2.3 The Contractor shall at the time of execution of the contract have a EPF Code Number obtained from the Authorities concerned under the Employees Provident & Miscellaneous Provisions Act, 1972 and remit contributions in respect of the employees employed by him at SLPP Site to the P.F office concerned every month failing which GIPCL will recover from the outstanding payment to the contractor from GIPCL.PF code of Gujarat region should be taken.
- 2.4. The Contractor shall maintain all records / registers required to be maintained by him under various labor laws mentioned above and produce the same before the Statutory Authorities whenever required.
- 2.5 The Contractor shall also submit periodical reports / returns to the various statutory authorities such as the Contract Labour (Regulation & Abolition) Act-1970, Employees Provident Fund Act etc. Under intimation to HR & Admn. Dept.
- 2.6 The Contractor shall not pay less than the Minimum Wages notified by the Government from time to time to his employees of corresponding categories.
- 2.7 The Contractor shall be responsible for payment of overtime wages to his workmen, if any, in case they are required to work beyond the prescribed hours under law as per applicable rates.
- 2.8 The contractor shall take Workmen Compensation Insurance Policy for all his employees working at GIPCL. The contractor shall indemnify the company against any liability due to any work injury or accident to any of its employees.
- 2.9 The Contractor shall in the event any of his workmen / employee sustains any injury or disablement due to an accident arising out of and in the course of his employment, provide necessary medical treatment and pay



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

compensation as applicable, required under the Workmen's compensation Act, 1923.

- 2.10 If any of the persons engaged by the Contractor misbehave with any of the officials or the Company or commit any misconduct with regard to the property of the Company or suffer from any serious communicable disease, the Contractor shall replace them immediately.
- 2.11 The Contractor shall not engage / employ persons below the age of 18 years. Employment of women shall be strictly according to applicable laws.
- 2.12 GIPCL will have right to deduct and disburse the claims of the individual / parties being a principal employer on any account whatsoever in relation to their employment with the contractor. The Security deposit will be released to the contractor at the end of the contractual tenure subject to an undertaking by the contractor that in the event any of his workmen or the heirs of workmen puts up a claim for recovery of money due to him from the contractor before the appropriate authority under the I.D.Act 1947 or under any other labor laws or for compensation under the Workmen's Compensation Act,1923 and the appropriate authority has given a direction for making payment the contractor will meet the same or indemnify GIPCL if in the event GIPCL pays it as Principal Employer.
- 2.13 The contractor shall make payment of wages to his employees on fixed date within the period specified under the applicable Law, in presence of representative of the company. He will submit a true copy of wage sheet, attendance register and P.F. remitted challans on monthly basis to HR&A dept. for verification and record.
- 2.14 The Contractor shall provide Safety items / kits to his employees such as safety shoes, goggles, ear plugs, hand gloves, safety belts etc., if any, required under the law.
- 2.15 The contractor shall conduct pre-induction and periodic medical checkup of his workmen as per applicable laws.
- 2.16 The Contractor shall be solely responsible for any accident caused to his workers and should adhere to all rules / regulations as per labor laws of Government and other statutory laws as applicable.



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

- 2.17 The Contractor should register himself under the Contract Labour Act, Employee Compensation Act and PF Act (Code no. to be mentioned) and submit the copy of registration certificate and should possess the same from the date of commencement of work, failing which the contract is liable to be cancelled. The E.C. Policy copy should be submitted to the GIPCL before commencement of the work and Labor License should be obtained within one week from the date of issue of form-V. Contractor should apply for Form-V immediately after receipt of LOI. A copy of Labour License shall be submitted to GIPCL, HR&A Department.
- 2.18 Contractor shall have to insure his workmen / supervisors etc. under Group Insurance scheme.
- 2.19 The Contractor shall be responsible for compliance of all statutory rules, regulation, act enforced from time framed by the government such as Factory Act, Employee Compensation Act, payment of ‘Wages Act’, Minimum Wages Act’, Provident Fund Act, All Labor Laws Act in respect of employees engaged by him for the work and shall have to maintain necessary records. In case any amount becomes due to be payable by him to his employees or to the Government under the above rules, regulation, Acts, GIPCL reserves the right to recover the same from the running bill of the contract.
- 2.20 Documentary evidence of deposit of PF paid shall have to be produced by the Contractor along with the next bill.
- 2.21 Records as per the provisions of various statutory Acts will have to be maintained by the Contractor and submitted as and when required.
- 2.22 All employees of Contractor should maintain due discipline and respect local sentiments. GIPCL reserves the right to direct the Contractor to remove any such person who does not comply with it.
- 2.23 The above list is indicative in nature and not an exhaustive one. Any amendment / alteration / Notifications or addition to the existing Law or a new statute shall automatically and immediately become applicable.



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

## **B. LEGAL ASPECTS**

1. Contractor shall maintain all register required under the Labour Laws and make the payment as per the Minimum Wages Act to the workers employed by him.
2. Contractor shall obtain requisite license to carry out this contract under the provisions of Contract Labour Act, 1970 and maintain necessary records and registers under the said Act.
3. Contractor shall submit a copy of each of the registration certificates with respect to Employees Provident Fund and Employee Compensation Act within one week time, from the date of award of this contract.
4. Contractor's employees, agent or sub-agent shall not smoke or light anything within the premises of the GIPCL and carry match box / lighter or any other explosive and /or inflammable material inside the plant.
5. Contractor shall abide by all the statutory rules and regulations like P.F., Labour Laws etc.
6. Contractor shall issue an appointment order to each casual laborer stating therein the nature of job to be performed by him and fix time for which the concerned workmen are likely to be deployed. Contractor shall also issue a temporary identity card specifying the period for which the workmen has been deployed.
7. Contractor is fully liable for the persons engaged by him for above work; however, GIPCL reserves the right to deduct any amount legally justified towards any liability not fulfilled.
8. Contractor shall indemnify GIPCL from any liabilities arising out of the employment of the manpower.
9. If the Contractor fails to complete the allocated job within specified time frame, GIPCL shall get the work done by third party at the risk and cost of Contractor.

## **10. PAYMENT OF WAGES**

Contractor shall be responsible for compliance of all statutory rules, regulation, act enforced from time framed by the government such as Factory Act, Employee



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

Compensation Act, payment of ‘Wages Act’, Minimum Wages Act’, Provident Fund Act, Payment of Bonus Act, Labour Law Act, maternity benefit act in respect of employees engaged by him for the work and shall have to maintain necessary records. In case any amount becomes due to be payable by him to his employees or to the Government under the above rules, regulation, Acts.

#### **11. ACCIDENT TO WORKMEN**

Contractor shall be fully responsible for injury or death of any of your or third party workmen due to any act omission / indiscretion on your part while undertaking the work and Contractor shall fully abide by the statutory requirements of the employee's compensation act. GIPCL shall not be liable for any compensation due to accident, death or injury to any of Contractor's workmen or any third party due to negligence, act or omission on your part.

#### **12. LIGHTING**

Necessary illumination at work area will be provided by GIPCL.

#### **13. NIGHT/SUNDAY/HOLIDAY SHIFT**

The Contractor shall depute qualified and adequate resources in Night shift / Sunday / holidays for any emergency job, which may come up at Night / Sunday / holiday.

#### **14. SAFETY ASPECT**

Contractor shall observe all the safety and security rules and regulation of the GIPCL which are at present in force and which may come into force during the pendency of the contract. Any violation of any rules and regulations will entail immediate termination of the contract.

When contractor moves his lifting tools and tackles to the plant area, required test certificates as per the Factory Act 1948 and the state factories rules has to be submitted to safety Deptt. Safety Deptt. will check the certificates and if found okay, then only materials will be allowed to enter inside the plant. Material inward gate pass will be made only after certification from Safety Deptt. Security Deptt. will inform to Safety Deptt., as & when such tools and tackles brought at the gate for making entry in the maintenance site.



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

The contractor has to submit the list of required safety gears along with safety equipments available with him to safety Deptt. Safety Deptt will check for quantity and quality of the safety gears and then allowed permission of work. Poor quality material will not be allowed to take inside the Plant. If quantity of required safety equipments is not satisfactory, contractor will not be allowed to carry out the work using such safety gears inside the Plant for the work.

## 15. GENERAL SAFETY CLAUSES

1. The Contractor shall observe and comply, with regard to his workmen working at the SLPP site, the safety norms as per the safety operating standards.
2. The Contractor shall ensure that his workmen are informed and trained regarding the safety standards to be adopted while operating within the SLPP Plant & Mines premises and the Contractor shall brief them regarding the same and use of the Personal Protective Equipment (‘PPE’).
3. The Contractor shall issue safety shoes and safety helmet of IS standard to all his workmen immediately on execution of the work and the Contractor shall ensure that his workmen wears the protective equipments at all times during the work operation. Contractor shall issue safety shoes every year. Brand name for safety shoe & safety helmet shall be suggested by safety representative of SLPP site. Such as : -

### Helmet:

Sr. No.	Model	Company	Specifications
01.	Tough Hat, HP-TH	Sure Safety	IS : 2925 – 1984, ANSI / ISEA Z89.1-2009
02.	V-Gard	MSA	
03.	PN 521 - Shelmet	Karam	

### Safety shoes:

Sr. No.	Model	Company	Specifications
01.	Acme Fabrik plast Co	SSTEELE (Strom) – Double Density	IS : 15298 – 2011



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

02.	Acme Fabrik plast Co.	TRIMAX(Adjacent) – Double Density	
03.	Worktoes Warren	Worktoes – Warren Plus	

4. Other safety gears like ear plug, dust mask, hand gloves, safety goggles, gum boots, full body safety uniform and belts, safety net etc. shall be issued and used as per the job requirements. Safety helmet shall be of YELLOW COLOUR ONLY. Contractor will procure safety shoes & safety helmet from a reputed company with at least 12 months' guarantee and shall produce the guarantee certificate and IS standard certificate to the safety department. Contractor should purchase safety shoes of reputed brands. Safety shoes will be issued every year. IS certificate and guarantee certificate must be obtained from the vendor and submitted to the Safety department. Safety shoes should be heat, water, oil and chemical resistant, having an anti-slippery sole of 15298- 2002 make.
5. It is the duty of Contractor to ensure that his workmen are wearing required PPEs as per work requirement. Contractor should ensure that their workers are wearing Safety helmet, safety shoes, dust mask, goggles, ear plug etc. at all times when they are at work throughout the contract period. The Contractor has to maintain the PPE issue registers with signature of workmen.
6. Contractor will reissue these PPEs in case of damage or misplacement of the same. Replacement shall be made immediately.
7. The Contractor shall be responsible for providing first aid or emergency medical help and treatment to his workmen in the event of any accident or injury.
8. If it is observed that Contractor is not issuing required PPEs timely and that of required quality, GIPCL will issue the required PPEs to contract workers and back charge the same with 25% overhead charges of GIPCL.
9. All lifting tools and tackles shall be duly certified by competent person in conformity with the statutory requirements and certificate in form no. 10 as per rule 60 of Gujarat Factories Rules, 1963 and section 29 of the Factories Act, 1948 shall be submitted every year before using such tools and tackles. In case of purchase of new lifting tools and tackles, form no. 10 as per the said rules shall be submitted before they are taken into use. All lifting tools and tackles shall be of reputed make having International manufacturing standard and shall be maintained in proper and workable condition.





**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

10. The Contractor shall nominate one Safety Officer with required qualification for supervising the daily job / shutdown jobs for observing and maintaining the safety aspects at site. He is solely responsible for any safety measures during maintenance work. He has to ensure that all the workmen working at site are equipped with essential PPE's and proper safety arrangement is made at the SLPP site.
11. After mobilization of any tools & tackles to site, which includes chain pulley blocks, D-shackles, wire ropes, winch machines, Mobile crane, Hydra etc. shall be offered for inspection with all above statutory test certificate before using at site for any work. They should use all tools and tackles only after certification by GIPCL representative / safety officer.
12. When working at height, working on ceiling or roof covered with fragile materials, full body harness safety belt, ladders and crawling boards shall be used to prevent accident. Further, during working on height, Contractor should arrange proper scaffolding of still pipes, safety net, full body safety belt, fall arrestor system etc. Advice and instructions of engineer in charge/ safety in charge shall be strictly complied with in this regard. All necessary safety precautions shall be taken by the Contractor to prevent accident and personnel injuries while working on height.
13. Flash back arrestors made of reputed manufacturer shall be provided on cutting torch, on DA cylinders and on O2 cylinder. Cylinder caps also required for handling the cylinders at the work at height area. Gas cylinders shall be transferred through gas cylinder trolley only with cylinder cap and stored up right (vertical) position only. All gas cylinders shall be hydro tested / certified as per gas cylinder rules 2004. Gas cylinders shall be stored, handled as per gas cylinder rules 2004.
14. All vehicles shall be operated by licensed drivers only. All vehicles' PUC to be tested as per Government approved RTO guidelines. All Vehicles must be parked in Parking space designated by GIPCL. If any vehicle is found inside the plant premises other than the parking area such vehicles shall be handed over to Security dept. and their entry shall be cancelled for movement inside the plant premises with immediate effect.
15. All electrical equipment shall be in good condition and free from any defect. Electrical tools & equipments i.e. welding machine, grinding and drill machine etc. may be checked by the electrical engineer of the Contractors regularly, every six month at least and report to be submitted to concerned HOD and safety dept.
16. During hot work, Contractor will use fire curtains like asbestos sheets or fire blankets to prevent falling and spreading of sparks and hot material on and



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

around the work area. Contractor will procure and use such items. ELCB / RCCB shall be provided with rating of 9-30 milli-ampere on welding machine and all portable power tools.

17. The Contractor shall fill – up Incident notification form (S-I), Incident Investigation form (S-II) and near miss report within time limit as specified in forms, if any accident, Incident, near miss occurred while working at SLPP site.
18. Major AMC / ARC Contractor (Where the man power strength is more than 50 and above) should appoint / nominate one qualified safety officer and he shall be responsible for addressing all the safety related aspects of execution of contract jobs and he will in close co ordination with safety officer of SLPP and attend all safety related meeting such as safety committee, on job safety training etc. Where the Contractual man power is less than 50, the Site In-charge of the Contractor will act as a Safety Officer and he will perform all the duties of safety officer as mentioned above.
19. No loose connection / joints allowed in electrical cables during performance of any kind of job.
20. Safety shoes to be issued to female employees also.
21. All the vehicles shall be fit as per RTO guidelines and valid fitness certificate is required as per RTO guidelines.
22. The Contractor's nominated safety officer shall be imparted regular on-job safety training like tool-box talk etc. and submit a record of such training in safety dept, respective dept and HR&A dept.
23. The Contractor shall comply all the new requirements related with safety as informed by the HOD / Safety department from time to time.
24. Penalty to be imposed for Violation of safety norms is proposed as follows:- The Contractor & Contract workmen shall strictly adhere to Safety standards / Guidelines as per practices. The list provided below is an indicative list to explain the principles behind safety practice. If the contract workmen fail to comply with safety standards as per category A, B & C below, penalty shall be levied on the Contractor as per the table mentioned below:

Category	Classification	Example / Cases	Penalty
A	PPEs Related	Working without shoes, dust mask, gloves, safety goggles etc.	Rs. 100 /- per instant.
B	WI Related	<ul style="list-style-type: none"><li>Failure to adhere to HSE guidelines / plans,</li></ul>	<ul style="list-style-type: none"><li>Rs. 500 /-</li></ul>



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

		<p>careless attitude in material handling,</p> <ul style="list-style-type: none"> <li>Machine being used with damaged machine guard, unsafe electrical work - workout plug top/improper electrical joints / cables lying on ground, electrical equipment working without proper earthing, machine being used without machine guard, Welding machine without ELCB / RCCB of proper rating, Gas cylinder without test certificate, Gas cylinder without test certificate, Cylinder cap, NRV / Flash back arrester, Cylinder trolley etc.</li> </ul>	<p>per instant.</p> <ul style="list-style-type: none"> <li>After three incidence, per incidence Rs. 2,500/-</li> <li>Continuous unsafe acts will disqualify the Contractor from further participation in tender of GIPCL-SLPP.</li> </ul>
		Unsafe working practices at height more than 3 meters.	
		Working without permit or non-compliance with permit conditions like hot work, height work etc. as applicable, lifting tools and tackles being used without third party inspection certificates in form no. 9/10 as per Factory Act – 1948 etc.	
C	Unsafe Practices	Breach of safe practices by a particular person repeatedly	<ul style="list-style-type: none"> <li>Suspend the entry gate pass for one week.</li> </ul>



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

		for three times	• After two suspensions his gate pass will be cancelled.
--	--	-----------------	--

Penalty so levied against the Contractors and company employees will be used during the observation of National Safety Day.

**The Contractor, workmen following good safety practices in their work area continuously will be rewarded / honored on National safety day.**

## 16. REJECTION OF WORK

If, as a result of inspection, examination or testing, the GIPCL's Representative / Engineer decides that any materials, work or workmanship is defective or otherwise not in accordance with the Contract, the GIPCL / Engineer / GIPCL's Representative may reject such plant, materials, work or workmanship and shall notify the CONTRACTOR promptly, stating his reasons. The CONTRACTOR shall then promptly make good the defect and ensure that the rejected item complies with the Contract. If Contractor failed to rectify the rejected work or workmanship, GIPCL / Engineer reserves the right to deduct or withhold amount against rejected work or Workmanship. CONTRACTOR shall not entitle for any claim or release of hold payment until rectify the defect up to satisfactory of GIPCL. If Contractor failed to rectify any such defective work or workmanship, GIPCL reserve the right to rectify at risk and cost of the CONTRACTOR and deducted by the GIPCL from any amount due, or to become due, to the CONTRACTOR's dues.

If the GIPCL / Engineer / GIPCL's Representative requires such materials, work or workmanship to be retested, the tests shall be repeated under the same terms and conditions. If such rejection and retesting cause the GIPCL additional costs for the traveling and lodging costs of GIPCL / Engineer's personal for attending the retest, such costs shall be recoverable from the CONTRACTOR by the GIPCL and may be deducted by the GIPCL from any amount due, or to become due, to the CONTRACTOR.

## 17. GENERAL TERMS AND CONDITIONS:

- All Equipment / Machinery, Tools & Tackles, Labour, equipments, vehicles, etc. to execute the contract are in the scope of the Contractor. The Contractor should ensure that tools & equipments are in healthy condition.



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

- The decision of the Engineer In-charge shall be final and binding on the Contractor for defining the terms and condition included in this contract.
- If the work is not found satisfactory, Engineer In-charge reserves the right to take suitable action.
- Contractor shall depute Location / Package wise full time independent experienced Site In-charge and two nos. independent site Supervisors at site. They shall co-ordinate with GIPCL Engineer In-charge and shall bear overall responsibility of contract including supervision. Inspection, Billing etc. Such person shall function from Site office of Contractor at SLPP.
- Contractor shall also nominate one safety supervisor at site and shall submit nomination of safety supervisor in writing before commencement of contract. Safety supervisor shall arrange small safety talk on every day morning or whenever required with all workers working under this contract. He shall coordinate with concern department's Engineer-in-charge on daily basis and report daily observations, tool-box talk records etc. GIPCL reserves the right to hold the work in case contractor not deployed / nominated safety supervisor and a penalty equal to Rs.1,000/- per working day absent of safety supervisor shall be levied from Contractor.
- Contractor shall strictly follow the existing work permit system of GIPCL and any future revisions.
- The Contractor has to take EC insurance policy / Off-duty insurance coverage for their workmen. The Contractor has to submit labor license and PF account number to the Engineer-in-charge before start the work.
- The Contractor has to do the job timely. GIPCL shall not compromise in delay. In case of delay of work without any valid reason, the GIPCL reserves the rights to carry out the work by deploying other agencies at the risk & cost of Contractor with additional 10% overhead charges.
- Contractor shall mobilize the resources as per need within the period of twenty four hours. If the contractor fails to mobilize sufficient resources to complete the job in time, GIPCL will execute the job through other agency at the risk and cost of the contractor with additional 10 % overhead charges.



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

- Contractor should mobilize all resources for efficient & smooth execution of contract within seven to fifteen days from the date of issue of Letter of Intent / Work Order.
- The prices / item rates quoted shall remain firm till completion of the contract and any agreed extensions thereafter and shall not be subject to any escalation, idle charges for labour, machinery, overhead expenses etc. due to any reason whatsoever. No price escalation / idle charges shall be entertained due to delay in work on unavailability of work front, unavailability of Contractor's supervisor, unavailability of Contractor's safety supervisor, violation of safety rules, and unsafe act by any of Contractor's worker, negligence & ignorance of safety & quality instructions of GIPCL Engineer-in-charge or any other reason whatsoever.
- Contractor must fulfill all the safety regulations and to take safety measures to avoid hazards. Contractor shall arrange all standard adequate healthy safety PPEs like but not limited to approved quality safety shoes & safety helmets, standard dust masks, safety goggles, etc. as required and shall use exclusively under this contract for all the time during working at specified locations failing which, the Engineer In-charge may hold the work and will take necessary action including penalty as decided. If the Contractor repeatedly violates safety rules / regulations (more than three successive incidents), Engineer In-charge may take necessary action against the Contractor, including appropriate financial penalty and / or termination of contract.
- Timely completion of all jobs and works shall be the essence of this Contract. Contractor should closely monitor each activities and complete the jobs as per the time given by and under the supervision of the Engineer In-charge and shall ensure that sufficient manpower / machinery / equipment is deployed for the same.
- Any job other than the listed jobs in work order shall be executed by the Contractor on instruction from GIPCL and payment shall be made to the Contractor on respective item rate only.
- The Government of India has enacted the Micro, Small and Medium Enterprises Development Act, 2006 (the “Act”) and the Act has come into force from October 2, 2006. The Bidder shall confirm whether your organization is registered under the Micro, Small and Medium Enterprises Development Act, 2006. If your organization is registered under the Act, please specify the category i.e., Micro Enterprise, Small Enterprise or Medium Enterprise under which it is registered





**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

and kindly attach a copy of your registration certificate.

- The Bidder shall provide details of registration along with copy of the registration certificate issued by the District Industries Centre / Department of Industries, etc of the respective State Government. It is to be noted that large scale industries and trading firms have been excluded from the purview of the Act.
- GIPCL is an ISO 9001, ISO 14001, OHSAS 18001 & ISO 50001:2011 (EnMS) certified company, and GIPCL gives extreme importance to maintain these global standards. Contractor shall be required to observe these standards while working with GIPCL. Contractor should ensure that his workmen / labour work in accordance with them.

## 18 CONTRACTOR'S SUPERVISION

The Contractor shall, during the whole time the work is in progress, employ a qualified experienced Site-In-charge of the works with adequate experience in handing of jobs of this nature and with the prior approval of the GIPCL / Engineer In-charge. Such Site In-charge shall be constantly in attendance at the site during working hours. During Contractor's Supervisor's absence during working hours, if unavoidable, and also beyond working hours, when it may be necessary to give directions, orders may be given by the GIPCL's Engineer In-charge and shall be received and obeyed by the Contractor's superintendent who may have charge of the particular part of the work in reference to which orders are given. If requested to do so, the Engineer / GIPCL shall confirm such orders in writing. Any directions, instructions or notices given by the Engineer / GIPCL to him, shall be deemed to have been given to the CONTRACTOR. The representative of the Contractor shall have all necessary powers to receive materials from the GIPCL, issue valid receipts for the same, engage labour or purchase materials and proceed with the work as required for speedy execution.

None of the Contractor's Superintendents, Supervisors or workmen should be withdrawn from the work without due notice being given to the GIPCL / Engineer further no such withdrawals shall be made if in the opinion of the GIPCL's Engineer In-charge such withdrawals will jeopardize the required pace of progress / successful completion of the work.

The Contractor shall employ in or about execution of the work only such persons as area careful, skilled and experienced in their respective trades, and the GIPCL shall be at liberty to object to and require the CONTRACTOR to remove any person





**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

employed by the Contractor in or about execution of works who in the opinion of the ENGINEER misconducts himself or is incompetent or negligent in the proper performance of his duties and all such persons shall not again be employed upon the works without the prior permission of the GIPCL.

Neither the Contractor nor the PURCHASER nor the ENGINEER shall hire or employ any employee of other party except by mutual consent.

## **19 CONTRACTOR TO REMOVE ALL OFFENSIVE MATTER IMMEDIATELY & CLEAN-UP**

All loose materials, wastage, packing materials, cut pieces or other matter of an offensive nature shall not be deposited on the surface, but shall at once be carted away by the CONTRACTOR to some pit or place provided by him away from the site of work and approved by local authorities.

As a part of the work included in this contract, the CONTRACTOR shall completely remove and satisfactorily dispose of all temporary works to the extent directed. He shall tear down and dispose of all temporary works, shall remove or grade, to the extent directed, all plant and equipment, shall satisfactorily dispose off all rubbish resulting from the operations under this contract and shall do all work necessary to restore the territory embraced within the site of his operations to at least as good order and conditions as at the beginning of the work under this contract.

## **20 FACILITIES TO BE PROVIDED BY GIPCL**

**A.** The Company shall provide the following facilities to the Contractor at the site:

- a. Electricity & water at nearest available one point. Further distribution to be done by contractor at their cost.
- b. Quarter(s) for supervisor/ engineers on chargeable basis in GIPCL's township at discretion of GIPCL if available.
- c. Workshop facility as available at site only. However contractor may visit the workshop to ensure the existing facility. For the facilities other than available, contractor has to carry out the job outside at their own cost.
- d. First aid facilities as available on chargeable basis.

Apart from the above, no other facilities shall be provided by GIPCL.

**B.** GIPCL shall also conduct an orientation program appraising the workmen regarding the safety norms and measures to be observed during work operations at the plant site.



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

## **21 WORK MEASUREMENT / CERTIFICATION**

- a. The work to be performed being a specialized nature, the contractor should be fully conversant with modern practices and should be able to carry out works independently of large thermal power plant. The contractor shall therefore be required to engage qualified / experienced personnel to undertake the work as per specifications and requirement.
- b. Contractor should maintain one computer with printer for keeping daily records and maintain the data.
- c. All the work measurements shall be jointly recorded in a measurement sheet / register / relevant documents by the contractor / authorized representative of the contractor and the Engineer-in-charge. The measurement shall be clearly written indicating date of measurement, location, reference to drawings, if any, and jointly signed.
- d. The Contractor shall be required to furnish satisfactory job completion report to GIPCL. The submission of report should be on daily basis. The monthly bill payment shall be released based on the certified reports of the works.
- e. Inspection of work will be done by Engineer-in-Charge or his authorized representative. If the work is not found satisfactory engineer in charge reserves the right to take suitable action and shall be binding to the contractor.

## **22 PUBLIC HOLIDAYS**

The contractor shall be responsible for giving benefit to all his employees, employed in whatsoever capacity, 09 Public / Paid holidays and the same shall be notified in advance and due communication thereof shall be made to the management.

## **22 BENEFIT PAYABLE IN CASE OF ACCIDENT OCCURRING OUTSIDE PREMISES OR BEYOND THE COURSE OF EMPLOYMENT**

The Contractor shall provide an insurance coverage (Medical + Death Benefit) for sum of Rs. 01/- Lakh to all his workmen / labour deployed at GIPCL-SLPP site for the accident taking place anywhere outside the Company premises or at any place when the workman is not in course of his employment.

## **23 FORCE MAJEURE**

The performance of the obligations herein contemplated may be suspended without incurring the penalty in the event of the subsistence of Force Majeure conditions. If



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

a Force Majeure situation arises, the affected Party shall promptly notify the other Party in writing of such conditions and the performance shall be suspended as per mutual agreement.

For the purposes of this clause, ‘Force Majeure’ means an event beyond the control of the Party and not foreseeable by the Party and shall include events of floods, explosions, riots, wars, hurricane, epidemics, any other Act of God, quarantine restrictions, terrorism, government actions and provided always that such acts result in the impossibility of the further performance of the contract.

## **24 INDEMNITY**

The Contractor shall indemnify and keep harmless GIPCL from and against all actions, proceedings, claims, demands, losses, costs, damages and expenses whatsoever which may be brought against or suffered by GIPCL which it may sustain, pay or incur as a result of or in connection with the performance / purported performance / non-performance of the contract by the Contractor.

In case, in any litigation pertaining to labour employed through contractor if any direction or order is issued by court at any point of time the contractor shall comply with and implement such direction or order whether passed at the time of award of contract or during the pendency of contract. Further, the Contractor shall indemnify the GIPCL against all consequences arising and affecting GIPCL owing to the compliance of the orders by the Contractor.

## **25 GOVERNING LAW AND JURISDICTION**

This tender document and contract shall be governed by the laws of India and the Courts at Baroda / Surat shall have jurisdiction regarding the same.

- 27.** Where any portion of the General Condition of Contract is repugnant to or at variance with any provisions of the Special Condition of Contract, then unless a different intention appears, the provision of the Special Conditions of Contract shall prevail to the extent of such repugnancy of variance.

\*\*\*\*\*



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

## **SECTION-D**

### **SPECIAL CONDITIONS OF CONTRACT**

#### **1. DETAIL SCOPE OF WORK**

The intent of this tender is to place order for Design, Engineering, Supply, Erection / Testing / Commissioning, Supervision and Performance Test of **One (01)** complete assembly of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipment for loading Fly Ash from Fly Ash Silo into closed body truck at Ash Handling System of “Surat Lignite Power Plant” as per the following Technical specifications and scope of supply:

#### **I. DESIGN BASIS**

<b>Particulars</b>	<b>Description</b>
<b>DESIGNATION</b>	Telescopic Type Bulk Loading Spout
<b>SYSTEM CAPACITY / UNLOADING RATE</b>	150 TPH (Dry basis)
<b>INSTALLATION</b>	Silo (Fly Ash Silo –Pressure system)
<b>MATERIAL TO BE LOADED</b>	Fly Ash (Lignite coal)
<b>BULK DENSITY OF FLY ASH</b>	800 KG/M <sup>3</sup> to 1100 KG/ M <sup>3</sup>
<b>FLY ASH TEMPERATURE</b>	100 °C
<b>TYPE OF FEED TO SPOUT</b>	Silo
<b>TYPE OF PRODUCT FEED CONTROL</b>	Pneumatically operated slide Gate Valve
<b>TYPE OF LOADING</b>	Enclosed Trucks / Bulklers
<b>LOADING CONTROL METHOD</b>	Rotary Feeder
<b>SILO AREATION SYSTEM</b>	Available, Fluidizing Air Blower (FAD :400 M <sup>3</sup> /HR)
<b>TOTAL AIR QUANTITY FED INTO SILO</b>	6400 M <sup>3</sup> /HR (Silo Loading Through Dense Phase Pneumatic Conveying System)
<b>SILO VENTING ARRANGEMENT</b>	Yes – By Vent Filter (Fan Capacity 8000 M <sup>3</sup> /HR, Fan static Pressure 250 MM WG)
<b>PERFORMANCE / SYSTEM CAPACITY TEST</b>	No Visible Emission of Fly Ash Dust (During truck loading operation). for minimum Ash unloading capacity of 150 Tonnes per Hour.



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

## II. SPECIFICATION - TELESCOIC TYPE BULK LOADING SPOUT

Particulars	Description
<b>APPLICATION</b>	Fly Ash Loading into Enclosed Trucks / Bulklers
<b>RETRACTED HEIGHT</b>	1384 mm
<b>VERTICAL TRAVEL</b>	2184 mm
<b>TOTAL EXTENSION</b>	3568 mm
<b>DRIVE</b>	<ol style="list-style-type: none"> <li>1. Heavy Duty worm gear box (Make: Siemens/ greaves (premium).)</li> <li>2. Electric Motor: Brake Motor (Make : Siemens/CG/ABB), TEFC Motor</li> </ol>
<b>BEARINGS</b>	Make : SKF/FAG/NTN only
<b>DUST OUTLET CONNECTION</b>	Vent Thru Inline Filter Module
<b>LIFTING ROPES</b>	Spliced steel ropes (Make: Usha Martine or equivalent, reputed make)
<b>ESTIMATED WEIGHT</b>	Maximum 450 Kgs. (Approx.)
<b>UPPER &amp; LOWER DRIVE LIMITS</b>	IP67 Full Up and Combination Full Down Limit Switches,
<b>INNER CONES</b>	Precision fabricated from Abrasive resistant material, 4MM (Min.) Thick, 200 AR STEEL/Hard plate material/Minimum 400 BHN.
<b>OUTER SLEEVE</b>	Urethane / Nylon with support rings
<b>DISCHARGE</b>	<b>Carbon steel construction, tapered design with Self sealing cones</b>
<b>PAINT</b>	(2) coat epoxy red oxide, (100Microns) (2) coat epoxy DA Grey, (50Microns) Total DFT – 150 microns



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

### III. SPECIFICATION - COMPACT FILTER MODULE (Inline dust collector) (PULSE JET MECHANISM)

Particulars	Description
APPLICATION	To collect dust, <b>Note :</b> 1. <i>To be inline and integral with loading spout.</i> 2. <i>To be accommodated in the existing space at site.</i>
TYPE	Cartridge Filter with Pulse Jet Mechanism with Pre piped Solenoid
FILTER MEDIA	Polyester Cartridges or superior
NET WEIGHT	Maximum 350 Kgs. (Approx.)
PRODUCT INLET	MOC: Precision fabricated from Abrasive resistant material, 4MM (Min.) Thick, 200 AR STEEL/Hard plate material/Minimum 400 BHN.
FILTER ACCESS Top Removal Design	Top Removal Design
VALVES	Make of diaphragm valve shall be ASCO with 110VAC supply in NEMA 4 Housing
PULSE TIMER	Pulse Jet Timer : Make of pulse jet timer shall be 'EAPL' ST10M1 model in NEMA 4 Housing
PRESSURE DIFFERENTIAL GAUGE	Magnahelic Dial Type, Mounted to Collector Housing
COLLECTOR HOUSING	Mild Steel as per IS2062
CLEAN AIR PLENUM CONSTRUCTION	Mild Steel as per IS2062
WITHDRAWAL FAN	AC induction Motor of Make : Siemens / CG / ABB, TEFC Motor
BEARINGS	Make : SKF/FAG/NTN only
VENT FILTER EXHAUST AIR QUALITY	< 30mg/Nm <sup>3</sup> ,
PAINT	(2) coat epoxy red oxide, (100Microns) (2) coat epoxy DA Grey, (50Microns) Total DFT – 150 microns



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

#### **IV. SPECIFICATION – ROTARY FEEDER**

DESCRIPTION	Rotary feeder with with Gearbox Motor
MATERIAL TO BE HANDLED	Fly Ash, Temperature of conveying material:100°C, Bulk density - 0.8 - 1.1 Tonne/M <sup>3</sup>
CAPACITY	150 TPH operating /160 TPH design
DRIVE ARRANGEMENT	Pin & Bush Type (Make-Fenner or equivalent)
ALL BEARINGS	Make : SKF / NTN/ equivalent.
WEAR BLADES	Spring steel
DUTY TYPE	Continuous
HOUSING	MS Fabricated IS: 2062-10 mm thk

#### **V. SPECIFICATION – PNEUMATICALLY OPERATED KNIFE GATE VALVE**

TYPE	Uni-directional Metal seated, Knife gate valve with Pneumatic actuator.
SIZE	300 NB
MAKE	Bray/Vass / Orbinox.
BODY MATERIAL	Alloy CI, Hardened to 350 BHN
GATE MATERIAL	SS304, edge stellingit & hard chrome on both side
END DETAILS	Drilling as per ANSI 16.5,Class 150

#### **VI. SPECIFICATION – MCC PANEL**

DESCRIPTION	Double door with extended canopy and Canopy should be separate from panel body, Non draw out Panel Enclosure, Fully wired and Tested With DCS Interface potential free contact.
MATERIAL OF SHEET METAL	Cold Rolled and cold annealed
SHEET THICKNESS	2 MM for Main frames / Base plate / Doors
CABLE ENTRY	Bottom
GLAND PLATE	3MM (10 SMG) HR thick removable





**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

TYPE OF PANEL	Non draw out type, Double door with extended canopy and Canopy should be separate from panel body.
DEGREE OF PROTECTION OF PANEL	IP55
OPERATING,MOUNTING,INSULATION	Projected type, single front, wall mounted, and indoor insulation.
RATED VOLTAGE	415 $\pm$ 10%, 50Hz $\pm$ 5%
INCOMING POWER SUPPLY	3 Phase, 3 wire AC 415 V, 50 Hz
CONTROL SUPPLY	110V AC
WIRING	1100V Grade
COLOR CODING	Control Wiring: (Phase – Grey), (Neutral-Black), 2.5sqmm cu cable. Power Wiring: Red, Yellow, Blue, Green, 3C / 4C Armoured copper cable. Size of power cable should be appropriate & should have sufficient margin of rating according to load.
CAUTION NOTICE	Caution notice in Hindi, English & Gujarati will be provided on panel front door.
CABLE TRAY	All power cable should be lay through cable tray of appropriate size. Cable tray & equipment earthing- strip is also required to install.(Material is in vendor scope)

#### **A. Supply:**

This shall include the Design, Engineering, Fabrication (*relevant General Arrangement / Structural Fabrication drawings shall be submitted for GIPCL's approval*) and Supply (*including Freight and insurance charges up to GIPCL – SLPP site*) of the complete Telescopic type bulk loading spout, with inline compact Filter module, Rotary Feeder, Push button control panel and allied equipments with Mandatory spares.



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

### **SCOPE OF SUPPLY**

<b>Sr. No.</b>	<b>Equipment</b>	<b>Qty.</b>
1	Telescopic Type Bulk Loading Spout	1 No.
2	Compact Filter Module (CFM)	1 No.
3	Rotary Feeder	1 No.
4	Pneumatic Operated Knife Gate Valve (300 NB)	1 No.
5	Pre wired MCC Panel	1 No.
6	Field cabling from MCC Panel	1 lot
7	All interconnection chutes, spool pieces	1 Lot
8	Compressed Air Piping to (CFM) with isolation valve	1 set.
9	Erection , Commissioning and Testing	1 No.
10	Mandatory Spares	
10	All other allied equipments associated with complete Telescopic type bulk loading spout with inline compact filter module, Rotary Feeder and MCC panel.	As per approved GA drawing.

#### **B. Erection / Testing / Commissioning at GIPCL – SLPP site:**

Deployment of Skilled Manpower by contractor for Dismantling of the old system and without damage to any nearby system or structure Erection of the complete supplied system comprising Telescopic spout, compact filter module, Rotary Feeder, Push button control panel, (Electrical & Automation / Instrumentation, Field wiring from MCC panel, complete in all respect) and allied equipments including the complete required structural supports / transition pieces supplied as per the approved GA / Technical drawings. (Civil work if any, is in GIPCL scope).



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

### **C. Supervision / Performance / System capacity Test:**

Supervision, considering the deputation of expert representative for the successful erection, testing and commissioning, up to Performance / capacity Test for the complete supplied system. The Performance of the complete system shall have to be proved for the No visible Emission of Fly Ash Dust during closed body Truck / bulker loading for minimum Ash unloading capacity of 150 Tonnes per Hour.

#### **❖ SPECIFIC REQUIREMENTS :**

1. Design should be suitable for accommodation the complete system in the space available at silo. Space availability for accommodating the complete system is indicated in the **attached drawing name SLPP Bulk Loading System (reference only)** since the dimensions are indicative only *Bidders are free to Visit the site and take measurement to avoid mismatches at later stage.*
2. G.A. / P&ID / Electrical drawings and documents of all the equipments / assemblies / system / spares to be submitted for review, information, and GIPCL approval.
3. Foundation drawing of telescopic spout assembly, venting arrangement and motor with static and dynamic loads, details of fixing, grouting and all relevant data required for design of foundation.
4. Operation philosophy is to be submitted for GIPCL approval, Provision of Selector switch on MCC Panel for Automatic / Manual operation, Provision for Interlocking or feed cut-off both with Level probe / sensor based and with Rotary Feeder (Time based on TPH rating of Rotary feeder), document should mention the sequence of operation and logic diagrams.

#### **The minimum required sequence of operation is as follows:**

(Note: Bidder also can propose better sequence of operation)

- I. Down and Up movement of spout on push button operation.
- II. Compact Filter Module can be made ON and OFF, both in Manual and Auto mode.
- III. Pneumatic Knife gate valve should open, both in Manual and Auto mode.
- IV. Pneumatic Knife gate valve closing, in Manual and also in Auto mode with Truck / bulker's Ash filled Level, in interlocking with probe / sensor based and Rotary Feeder's ON and OFF (Time based) feedback.
- V. The system should be operated by activating auto selection from the selector switch. There should be interlocks for each feeder in Auto mode to control whole operation automatically.



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

The following sequence of AUTO operation is to be followed for starting and stopping of drive motor:

- After ensuring vehicle position, bulk loading spout motors will start down motion by pressing respective push button which is mounted on the MCC / pendant.
  - Spout to be positioned on the truck hatch.
  - Select the Rotary feeder ON Time with selector switch for Time based operation (Time based on TPH rating of Rotary feeder) of Rotary feeder to fill the truck / bulker.
  - Then Compact filter module motor switched ON, simultaneously purging timer switched ON. Soon after Rotary feeder and Pneumatic knife gate valve should open.
  - Once the material is full in the vehicle then level full signal or if ON time of Rotary feeder is complete (whichever is earlier) will be received from Pneumatic probe or Rotary feeder motor, this signal is linked up to on delay timer so that the Respective Pneumatic gate closes, Rotary Feeder Motor stops, CFM Blower is switched OFF automatically.
  - After closing of all the gates then spout will be taken up manually until Full up limit switch activates.
5. Vendor shall Submit Master Schedule for Design, Engineering, Supply, Erection / Testing / Commissioning.
  6. Vendor shall depute Expert Engineer for Erection, commissioning and Capacity Testing of supplied System as per the communication from GIPCL. (Intimation for Erection & commissioning (E&C) shall be given well in advance and same shall be as per the availability of Silo for E&C jobs.)
  7. List of make of all components including that of bought out items.
  8. Trouble shooting & rectification of defects if any, occurring in the supplied system at free of cost during warranty period, Training to our Engineers / Operators regarding Operation and Maintenance of the System shall be in bidders scope.



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

9. Bidder shall submit List of spares, Bill of Material, list of mandatory spare to be maintained for uninterrupted operation of complete system along with vendor details.
10. Supply of spares as and when ordered by GIPCL after warranty period.(For minimum 10 years).
11. Catalogues data sheets and drawings for Mechanical / Electrical / instrumentation etc.(Soft copy with 3 Set of hard copies).
12. Operation and Maintenance Manual. .(Soft copy with 3 Set of hard copies).
13. Bidder shall furnish all the Material Test certificates, Test certificates, Inspection report and relevant legal documents shall be produced along with consignment.
14. Laisoning (if any) fee will be in your scope.

## **1.2 FAILURE DURING EMERGENCY**

During any emergencies, contractor shall have to carry out the work by deploying additional force within twenty four hours notice period failing which GIPCL reserves the right to carry out this work by engaging other party. The expenditure occurred due to such situations, the contractor will be held responsible & the same will be recovered from the contractor's monthly bill / any other pending bills along with 10% overhead charges. For repetitive failure of such work for more than two incidents, GIPCL reserves the right to terminate the entire contract by forfeiting all pending dues, security Deposit & other retention money, if any, after giving 15 days notice to contractor & this will be binding to the contractor.

## **1.3 DISPOSAL OF SCRAP**

Contractor shall be responsible for removal and disposal of all the scrap materials, old removed structures, consumables etc... as per prevailing GPCB norms outside GIPCL premises on every billing period basis. GIPCL will not be held responsible for any subsequent consequences regarding improper disposal of scrap by the contractor.

## **1.4 GENERAL SCOPE OF CONTRACTOR**

1. All tools & tackles, tractors, required vehicles to execute the contract will be in the scope of the contractor. The contractor should ensure for healthiness / working conditions of tools, tackles, equipments & vehicles.



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

2. All consumable items like cloth, cotton waste, kerosene, gas, diesel, lubricants, welding electrodes, etc will be in the scope of the contractor.
3. All safety/PPEs required during work at site are to be arranged by the contractor.
4. The Contractor shall have to provide necessary facilities including accommodation for their labour at their own cost.
5. The contractor has to arrange transportation for tool & tackles, lifting / shifting the materials of their own.
6. Contractor has to depute their full time experienced site-in-charge & independent Location / Package wise supervisors for work execution as per specification and for day to day work planning & coordination with respective department's Engineer-in-charge, to obtain day to day Location wise work permits, to get daily location wise work supervision, to record Location wise joint work done reports / measurements, to prepare & apply for manpower gate pass, to maintain location / package wise statutory & legal compliance records, etc.
7. Contractor has to maintain record of each and every material brought to site with material test certificate and gate entry.

## **1.5 SCOPE OF GIPCL**

Available Electric power, water & air, shall be provided free of charges at any one point nearer to work site as convenient to GIPCL. Contractor shall make his own arrangements for drawl and distribution to the work site. However before drawl of such energy, contractor shall take prior permission of the same.

However, due to unavoidable circumstances or any other reason whatsoever, on unavailability of power supply or water, contractor shall proceed with the scope of work by making own alternate arrangements without any extra cost to GIPCL. GIPCL will not be held responsible for the delay, interruption or denying for power supply and water due to any reason whatsoever. Any Type of civil work, foundations etc shall be in GIPCL's scope.

## **1.6 TO REMEDY DEFECTIVE WORK**

If the work or any portion thereof shall be damaged in any way excepting by the acts of the GIPCL, or if defects not readily detected by proper inspection shall develop before the final completion and acceptance of the whole work, the



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

CONTRACTOR shall forthwith make good, without compensation, such damage or defects in a manner satisfactory to the ENGINEER / GIPCL. In no case shall defective or imperfect work be retained even if contractor followed all technical specifications. GIPCL will not compromise for quality of materials, works & workmanship.

The CONTRACTOR shall remain liable under the provisions of this clause notwithstanding the passing by the GIPCL of any certificate, final or otherwise or the passing of any accounts.

## **1.7 DAILY DIARY AND PROGRESS REPORT**

A daily diary register will be kept in the ENGINEER'S office. The CONTRACTOR will supply all detailed information every day at 9:00 hours for the day preceding and the diary will be jointly signed by the ENGINEER and the CONTRACTOR'S representatives, every day in token of its correctness. A works instruction book, serially numbered will also be kept in the ENGINEER'S office and all day to day instructions will be given in that book. The CONTRACTOR'S representative shall report every day to see these instructions and sign them at the bottom in token of his having seen them.

The CONTRACTOR shall supply all information regarding procurement of materials and progress of work, as is required by the ENGINEER for compiling the weekly progress reports. This information shall be supplied by 9:00 hours on every Monday, for the preceding week.

## **2. PRICE & RATES**

The rates quoted by Bidder in the online Price Bid shall be inclusive of cost of all Labor, Supervision, cost of safety supervisor, Shifting transportation, loading, unloading, equipment, all Tool & Tackles, safety equipments, PPEs, Royalties, Rents, GST, Stamp Duties, Turn Over tax Central or State Government or Local body or Municipal Taxes, Work contract tax, and / or any other duty / tax, levied by the Central, State Government or other Public bodies etc. and such other costs that are not specifically mentioned herein but will be incurred by the contractor for the satisfactory and timely completion of the work. The quoted rates shall be deemed to include for everything mentioned in the specification, all leads & lifts, contractor's overheads & profits for due performance of the work under this contract and such other costs that are not specifically mentioned herein but will be incurred by the contractor for satisfactory and timely completion of the work. The rates shall also





**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

include cost for mobilization / demobilization of manpower, equipments, materials, etc.

The rates shall be firm for entire contract period and also during extension, if required and shall not be subject to any escalation in prices, idle charges for labour, machinery, overhead expenses etc. No price escalation / idle charges shall be considered due to any reason whatsoever. No price escalation / idle charges shall be due to any reason whatsoever.

The prices / item rates quoted by bidder shall remain firm till completion of the contract period and any agreed extensions thereafter and shall not be subject to any other escalation, idle charges for labor, machinery, overhead expenses etc. No price escalation/ idle charges shall be payable due to delay in work by contractor due to non – availability of work front by GIPCL or any reason whatsoever.

The price / rate quoted by CONTRACTOR shall be considering mobilization of all required manpower, tools & tackles, materials, equipment for timely and satisfactory completion of all scope of work.

The value and /or quantum of work may be increased or decreased depending upon day to day requirement. However item rates remains unchanged and the payment shall be made as per the actual quantity executed as informed & certified by GIPCL representatives.

### **3. CONTRACT PERIOD**

1. The Contract period will be **12 (Twelve) months** from the date of issue of Lol or Work Order (whichever earlier).
2. GIPCL reserves the right to extend the contract period up to 3 months on the same rates, terms and conditions without any price escalation and without entering into any new contract.
3. The said contract period can be extended if mutually agreed upon by both the parties up to one year and in such case a revised work order shall be issued at the same rates and terms & condition or at negotiated rates acceptable by both parties i.e. Company & the contractor.



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

#### 4. TERMS OF PAYMENT

**Payment shall be made as per following:**

Sr. No.	Particulars	Payment Terms
1.	Supply	<b>70%</b> payment of Total cost / invoice along with 100% taxes shall be released within 30 days on acceptance of and submission of invoice subsequent to supply of material and receipt / regularization of the same at GIPCL- SLPP site
2.	Erection & commissioning	Balance <b>20%</b> payment of total cost shall be released after successful Erection and Commissioning of the supplied system.
3.	Performance /System Capacity Test	Balance <b>10%</b> payment of total cost shall be released on successful system capacity test. Payment shall be released after 30 days performance observation period of the complete system for satisfactory performance as per system capacity test.

##### **A. Conditions of Payment:**

The contractor shall raise running invoice / Final bill / Invoice in three copies for work performed or completed along with the documents as mentioned hereinafter. On receipt of the invoice complete in all respects and with all the said documents, the payment in respect of the same shall be made within 30 days of such receipt of a complete invoice and acceptance of invoice as per the following procedure of payment:

- (i) The bidder shall submit Total bill / invoice along with 100% taxes as per schedule of Lump-sum price under contract price and payment shall be released within 30 days on acceptance of and submission of invoice subsequent to supply of material and receipt / regularization of the same at GIPCL- SLPP site, against the work executed duly certified by GIPCL. Income Tax (IT) will be deducted at source from bills as per the rules in force.
- (ii) Security deposit at 10% of contract value excluding taxes & duties shall be submitted as per clause no.: 1 of Section-C. Security deposit will be returned to



**Tender Document for** : Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

the contractor without any interest after successful completion of defect liability period / Performance Guarantee / Warrantee period.

(iii) GST shall be paid along with bills after fulfillment of following terms.

- a) Submission of copy of registration certificate issued by GST Authority (to be furnished only once).
- b) Citing The Goods and service Tax Registration no. And the date of issue of registration certificate on invoices.
- c) Claim of GST amount with percentage (%) separately shown on the invoices.
- d) The contractor shall be required to submit the proof of payment of GST of previous month / quarter, as may be applicable as & when demanded by GIPCL / Owner / company.
- e) Contractor shall inform the Owner in the event of its registration certificate is cancelled or discontinued for whatsoever reason.

(iv) At the time of submission of the Bill / Invoice, the Contractor shall submit a certificate from Engineer-in-charge regarding availability of tools & tackles, equipments, etc at site as desired by GIPCL. The Contractor shall also furnish the checklist as per **ANNEXURE- A** enclosed with the **Section-F** of tender document along with the RA bill of respective month **if applicable**.

(v) While making running account payment, the following deductions may be made by GIPCL, **if applicable**:

1. Cost of material issued, if any, by GIPCL and to extent consumed in the work.
2. Security deposit recoverable if any.
3. Advance of materials / work progress advance payments, if any.
4. Penalty for delayed delivery, penalty for delayed execution of work, recovery of charges for the work done by other contractor due to delay or any other reason, if applicable.
5. Any other dues recoverable by GIPCL from the contractor under the contract.



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

- (vi) The contractor along with RA Bill / Final Bill shall submit copy of P.F. Challan, wages register of previous month, attendance sheet of respective month & ECR statement indicating the employee & employer's P.F. contribution of previous month with respect of employees employed by him for the contract at GIPCL site, **if applicable**.
- (vii) The Contractor shall submit his Final Bill within a period of four months of the expiration or earlier termination of the contract or any extensions that may be granted by GIPCL to the Contractor. GIPCL shall not entertain any bill for any work item after expiration of period of four months.
- (viii) The contractor shall include all his claims in the Final Bill submitted by him and accordingly the final bill submitted by the contractor shall be deemed to be inclusive of all and whatsoever the claims that the contractor may have from GIPCL. The contractor shall not be entitled to claim any amounts which are not mentioned in the Final bill and shall not be entitled to recover the same from GIPCL subsequent to the submission of the Final Bill on any account and GIPCL shall stand absolved of all its liabilities in respect of any such claims not raised by the contractor in his Final RA bill / Bill.

#### **B. Validity and Uniformity of Rates:**

The rates shall be valid for the contract period and agreed extension and shall remain unaltered during the contract period.

### **5. DELIVERY SCHEDULE AND PENALTY FOR LATE DELIVERY AND EXECUTION**

- 5.1 Design and submission of G.A. / P&ID / Electrical Drawings for approval within 2 to 4 weeks from the date of receipt of Lol / Work Order.**
- 5.2 Supply of Equipments, Assemblies, Spares / system (complete in all respect) within 16 weeks from the date of receipt of Approved drawings from GIPCL.**
- 5.3 Mobilization of Manpower, Tools & Tackles within 7 days from the date of intimation for execution of Erection & commissioning (E&C) work, within 12 days from the start of work or work permit clearance.**



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

**5.4** In case of delayed delivery except for Force Majeure cases, penalty amounting to the 0.25% of the total work order value for every two (02) weeks of delay in supply shall be levied by GIPCL for late supply maximum up to 10% of the total work order value (excluding Taxes & Duties).

**5.5** Penalty amounting to Rs. 1000/- per day for delay in execution of Erection & commissioning work shall be levied by GIPCL for delay in work maximum up to 10% of the total work order value (excluding Taxes & Duties).Maximum penalty pertaining to delay in supply and execution of work shall not exceed 10% of the total work order value (excluding Taxes & Duties).

## **6. PRE- DISPATCH INSPECTION**

Bidder shall give pre dispatch inspection notice for deputing GIPCL Executive for Inspection.

## **7. DEFECT LIABILITY PERIOD**

Defect liability period shall be 12 months from the date of commissioning of the system. The Bidder shall GUARANTEE / WARRANTY the performance of the equipment individually as well as the system as a whole / spares against defective supply / satisfactory performance of the system, throughout the defect liability period.

If any defect developed during the defect liability period the firm shall either repair the equipment or replace the defective parts by new at their cost to the Satisfaction of GIPCL authorities.

## **8. LOSS AND DAMAGES**

Any loss or damages and deterioration to the material in transit shall be at the cost of the suppliers. It shall be at the discretion of the GIPCL to reject the damaged or spoilt material, if so noticed.

## **9. INVOICE**

Original invoice should be sent at GIPCL-SLPP Site. (Mention the LoI / Work Order / Purchase Order No. in Invoice and Challan without fail).

## **10. APPROVAL**

The Material supplied will be subject to GIPCL approval and inspection at



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

GIPCL-SLPP premises. Our decision for acceptance or rejection of the goods will be final and binding on you.

## **11. TRANSIT INSURANCE**

The goods supplied under the contract shall be fully insured against loss or damage incidental to manufacture or acquisition, transportation, storage and delivery to destination. Insurance is to be provided by the supplier at his cost.

## **12. QUANTITY OF SUPPLIED MATERIAL**

Quantity recorded at our GIPCL-SLPP site will be taken as the basis of payment.

## **13. FAILURE & TERMINATION**

If the SUPPLIER after receipt of written notice from the GIPCL / ENGINEER requiring compliance, with such further drawings and / or the GIPCL / ENGINEER instructions fails within seven days to comply with the same, the GIPCL / ENGINEER may employ and pay other agencies to execute any such work whatsoever as may be necessary to give effect thereto and all costs incurred in connection therewith shall be recoverable from the SUPPLIER by the GIPCL on a certificate by the GIPCL / ENGINEER as a debt or may be deducted by him from any money due or to become due to the SUPPLIER.

## **14. SUBMISSION OF TECHNICAL DOCUMENTS TO THE ENGR-IN-CHARGE**

Contractor shall submit following documents to the Engineer-in-charge for verification purpose of the bill:-

- (i) **Measurement sheet (as per mode of measurement) along with joint record of work done in the form of joint inspection report** duly signed by authorized representative of contractor and GIPCL Engineer. The bill will not be entertained without submission of above documents.

## **15. SUBMISSION OF STATUTORY COMPLIANCES WITH EACH BILL**

Contractor shall submit each RA bill / Bill of work carried out along with following documents, if applicable,

- (ii) Copy of statutory compliance like labour license, wages payment register, EC Policy, PF paid Challan with ECR, etc... along wage certificate pertaining to



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

respective bill period.

(iii) Written undertaking of site clearance with final bill.

(iv) Notarized Indemnity Bond in case of Final bill.

(v) No claim - No arbitration certificate as per Performa (**Annexure-E**), after releasing final bill payment.

Bill submitted without any of the above documents shall not be processed for payment.

## **16. MOBILIZATION AND EXECUTION**

- a) Contractor shall mobilize the resources at site within 03 days from the time of intimation given by GIPCL.
- b) Contractor shall provide independent site supervisor who will be responsible for supervision and execution of job in specified time with respect to quality, specifications, site preparations, safety, co ordination with GIPCL, issue of work permits, joint measurements, etc... The supervisor shall coordinate with the Engineer-in-charge of GIPCL for proper execution of the job.
- c) The resources required for execution of above jobs will vary from time to time, hence contractor shall mobilize the resources accordingly.
- d) Contractor shall provide accommodation for the persons deployed by him for the work at his own cost.

## **17. QUANTITY OF WORK**

The estimated quantities of work required to be carried out by the contractor are as given in the section-E (Schedule of quantity). Estimated and shall vary accordingly to the exigency of work at site. However, the rates quoted by bidder shall remain firm irrespective of any variation in estimated quantities. Contractors shall engage required nos. of labors along with the required tool & tackles as per work load and emergency situations throughout the contract period to perform his contractual duties.





**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

In case, contract quantity / amount exhausted before completion of contract period, GIPCL reserves the rights to increase the quantities or contract amount for successful completion of entire contract period. Contractor shall responsible to complete the particular job up to entire satisfaction of Engineer-in-charge. The item rates remain firm & unchanged till completion of the contract and any agreed extensions thereafter and shall not be subject to any escalation, idle charges for labor, machinery, overhead expenses etc. for any reason whatsoever. The quantum of work of individual item may be up to any extent depending upon requirement. However, item rate remains unchanged. Under the contract, contractor has to execute all work as per the Plant requirement.

## **18. COVID-19**

It is well aware about nationwide spread of COVID-19 pandemic for which Government of India as well as Government of Gujarat is circulating various guidelines/advisory time to time for prevention of spread & protection of human being. GIPCL also being a responsible organization, implementing such guidelines along with specific directions & advisories to all employees, contractors & workers on time to time.

All the interested parties, bidders, successful contractors shall have to follow at their own cost all such instructions, advisories, guidelines related to COVID-19 which are at present in force and which may come into force. In order to implement such guidelines, all required expenditures towards providing approved mask, sanitizer, medical assistance, etc, shall be in the scope of contractor.

## **19. GENERAL CONDITIONS OF CONTRACT**

General Conditions of Contract (Section-C) and detail specification prepared by the company will be applicable for this contract. The same is enclosed herewith. Bidders are advised to go through the same.

Where any portion of the general conditions of contract is repugnant to or at variance with any provisions of the special conditions of contract, then unless a different intention appears, the provision of the special conditions of contract shall prevail to the extent of such repugnancy of variance.

\*\*\*\*\*



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

## **SECTION – E**

### **SCHEDULE OF QUANTITIES AND PRICE**

<b>PRICE BID FORMAT</b>				
<b>NAME OF WORK:</b> <b>Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo.</b>				
Sr. No.	Description	UoM	Quantity	Total Quoted Price in Rs.
1	<p><b>A. Design, Engineering, Supply (<i>including Freight charges up to GIPCL – SLPP site</i>) of complete Telescopic type bulk loading Spout with inline compact filter module, Rotary feeder, Local control panel, allied equipments, and mandatory spares as per ANNEXURE-D of Tender document.</b></p> <p><b>B. Supervision considering the deputation of Expert representative for the successful Erection (Deployment of Manpower with required Tools &amp; tackles) of the complete supplied system, as per approved drawings and the detailed scope of work mentioned in Tender document. Testing and Commissioning, up to the satisfactory performance of the complete supplied system. The performance shall have to be proved for the minimum Ash unloading capacity of 150 Tonnes per Hour.</b></p>	No.	1	
2	<b>Applicable GST in Rs.</b>			
3	<b>Total Price (1+2)</b>			
<b>(RUPEES</b> <div style="border-bottom: 1px solid black; height: 15px; width: 100%;"></div> <div style="text-align: right; padding-top: 5px;"><b>ONLY)</b></div>				



**Tender Document for** : Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

**Note:**

- 1. All above prices shall be quoted through online only. Hard copy of price bid shall not be considered / accepted.**
2. The rates shall include all Packaging & Forwarding, Freight & Insurance charges, labour cost, equipments, supervision, consumables, tools & tackle, all taxes & duties, (*excluding GST, GST shall be paid extra at actual*).
3. Evaluation of tender will be done on gross total quoted amount with GST.

**COMPANY SEAL & SIGNATURE**

.....

**NAME OF AUTHORISED PERSON**

.....

**DESIGNATION OF AUTHORISED PERSON**

.....

**COMPANY**

.....

**DATE**

.....



**Tender Document for** : Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

## **SECTION – F**

### **LIST OF ANNEXURES & FORMS**

#### **1.0 ANNEXURE - A**

##### **CHECKLIST FOR PASSING THE BILLS**

For the month of:

- |  |   |                                      |    |             |
|--|---|--------------------------------------|----|-------------|
| 1) Work Order / P.O. No. & Contract value                      | : |                                      |    |             |
| 2) Nature of work  | : |                                      |    |             |
| 3) Duration of Work Order                                      | : | From                                 | to |             |
| 4) Maxi. No. of manpower per day Deployed in the month.        | : | M                                    | F  | Total       |
| 5) Details of Labor License                                    | : | Valid up to                          |    | for Persons |
| 6) Details of E.C Policy                                       | : | Valid up to                          |    | for Persons |
| 7) Documents attached for verification For the previous month. | : | Wage & Attendance Sheets.            |    | Yes / No    |
|  |   | P.F Challan                          |    | Yes / No    |
| 8) Documents attached for verification (in case of Final Bill) | : | Bonus Payment Register               |    | Yes / No    |
|  | : | Leave wage register                  |    | Yes / No    |
| 9) Security Deposit / Retention Money                          | : | Yes / No, if yes, Rs. lying with Co. |    |             |

Date:

Signature of Contractor  
With official stamp



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

## 2.0 ANNEXURE - B

### PROFORMA FOR CONTRACT SECURITY DEPOSIT – CUM – PERFORMANCE GUARANTEE BY SELLER / CONTRACTOR

(To be stamped in accordance with stamp act)

B. G. No. \_\_\_\_\_ Date: \_\_\_\_\_

1. WHEREAS M/s. Gujarat Industries Power Company Limited having its corporate office at PO: Petrochemicals, Dist. Vadodara – 391346, Gujarat State, India (hereinafter called “The Company Owner” which expressions shall unless repugnant to the subject or context includes its legal representatives, successors and assigns) has entered into a contract with M/s...../has placed a purchase order on M/s.....(hereinafter referred to as “Contractor(s)/ Seller(s)” which expression shall unless repugnant to the subject or context includes their legal representatives, successors and assigns) for.....on the terms and conditions as set out inter alia, in the Company's contract No./ P.O.No.....date .....and various documents forming part thereof hereinafter referred to as the “said contract” which expression include all amendments, modifications and / or variations thereto and where as the Contractor (s) / Seller(s) has agreed for due execution of the entire contract and guarantees its performance including any parts executed through any other agencies / subcontractors

AND WHEREAS on of the conditions of the “said contract” is that “contractor(s) / seller(s) shall furnish to the owner a Bank Guarantee from a bank for ....% (.....percent) of the total value of the “said contract” against due and faithful performance of the “said contract” including performance guarantee obligations of the contractor(s) / seller(s)for execution / supplies made under the “said contract.”

2. We .....Bank having its branch office at .....do hereby agree and undertake to pay the amount due and payable under this guarantee without any demur merely on a demand from the Company stating that in the opinion of the Company, which is final & binding, the amount claimed is due by reason of default made by the Contractor(s)/ Seller(s) in performing any of the terms & conditions of the said Contract including defect liability obligations, in fulfilling the performance guarantee obligation or



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

loss or damage caused to or would be caused to or suffered by the Company by reason of any breach by the said Contractor (s)/ Seller(s) of any of the terms & conditions of the contract. Any such demand made on the Bank by the owner shall be conclusive as regards the amount due and payable by the Bank under this guarantee. However our liability under this guarantee shall be restricted to Rs. .... (Rupees.....only).

3. We undertake to pay to the Company any money so demanded notwithstanding any dispute or disputes raised by the contractor(s)/ Seller(s) in any suit or proceeding pending before any office, court or tribunal relating thereto our liability under this present guarantee being absolute and unequivocal. The payment so made by us under this bond shall be a valid discharge of our liability for payment there under. Our liability to pay is not dependent or conditional on the owner proceeding against the Contractor(s)/ Seller(s).
4. The guarantee herein contained shall not be determined or affected or suspended by the liquidation or winding up, dissolution or change of constitution or insolvency of the said Contractor(s)/ Seller(s) but shall in all respect and for all purposes be binding and operative until payment of all money due or liabilities under the said contract(s)/ Order(s) are fulfilled.
5. This guarantee will remain valid up \_\_\_\_\_ days or \_\_\_\_\_ whichever is earlier. The Bank undertakes not to revoke this guarantee during its currency without previous consent of the OWNER / PURCHASER and further agrees that if this guarantee is extended for a period as mutually agreed between bidder & owner / purchaser, the guarantee shall be valid for a period so extended provided that a written request for such extension is received before the expiry of validity of guarantee.
6. We .....Bank further agree with the Company that the company shall have the fullest liberty without our consent and without affecting in any manner our obligations hereunder to vary any of the terms and conditions of the said Contract(s) / Order(s) or to extend the time of performance by the said Contractor(s) Seller(s) from time to time or to postpone for any time or from time to time any of the powers exercisable by the Company against the said Contractor(s)/ Seller(s) and to forbear or enforce any of the terms and conditions relating to the said Contract(s)/ Order(s) and we shall not be relieved from our liability by reason of any such variation, or extension being granted to the said Contractor (s) / Seller(s) or for any forbearance,



**Tender Document for** : Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

act or omission on the part of the Company or any indulgence by the Company to the said Contractor(s)/ Seller(s) or by any such matter or thing whatsoever which under the law relating to sureties would, but for this provision, have affect of so relieving us.

7. Notwithstanding anything contained herein before, our liability shall not exceed Rs.....(Rupees.....only) and shall remain in force till.....Unless a demand or claim under this Guarantee is made on us within three months from the date of expiry we shall be discharged from all the liabilities under this guarantee.

Date.....

Corporate Seal of the Bank

.....Bank

By its constitutional  
Attorney Signature of  
duly Authorized person

On behalf of the Bank  
With Seal & Signature code





**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

### **3.0 ANNEXURE - C**

#### **PROFORMA FOR BANK GUARANTEE FOR EARNEST MONEY DEPOSIT**

(To be stamped in accordance with Stamp Act)

B. G. No. \_\_\_\_\_ Date: \_\_\_\_\_

1. WHEREAS M/s.Gujarat Industries Power Company Limited having its Corporate Office at PO: Petrochemicals, Dist.Vadodara – 391 346, Gujarat State, India (hereinafter called “The Company Owner” which expression shall unless repugnant to the subject or context includes its legal representatives, successors and assigns) has issued tender paper vide its Tender No.....for -----  
------(hereinafter called “the said tender”) to M/s.....(hereinafter called the said Tenderer(s)” which expression shall unless repugnant to the subject or context includes their legal representatives, successors and assigns and as per terms and conditions of the said tender, the tenderer shall submit a Bank guarantee for Rs..... (Rupees.....only) towards earnest money in lieu of cash.
2. We.....Bank having its branch office at..... do hereby undertake to pay the amount due and payable under this guarantee without any demur, merely on a demand from the Company stating that in the opinion of the company which is final and binding, the amount claimed is due because of any withdrawal of the tender or any material alteration to the tender after the opening of the tender by way of any loss or damage caused to or would be caused or suffered by the Company by reason of any breach by the said tenderer(s) of any of the terms and conditions contained in the said tender or failure to accept the letter of Intent Agreement or that the amount covered under this Guarantee is forfeited. Any such demand made on the Bank by the owner shall be conclusive as regards the amount due and payable by the Bank under this guarantee, However, our liability under this guarantee shall be restricted to an amount not exceeding Rs.....(Rupees.....only).
3. We undertake to pay to the Company any money so demanded not withstanding any dispute or disputes raised by the tenderer (s) in any suit or proceeding pending before any office, court or tribunal relating thereto our liability under this present guarantee being absolute and unequivocal. The payment so made by us under this bond shall be a valid discharge of our



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

liability for payment there under. Our liability to pay is not dependent or conditional on the owner proceeding against the tenderer.

4. The guarantee herein contained shall not be determined or affected or suspended by the liquidation or winding up, dissolution or change of constitution or insolvency of the said tenderer(s) but shall in all respect and for all purposes be binding and operative until payment of all money due or liabilities under the said contract(s)/ Order(s) are fulfilled.
5. We .....Bank Ltd. further agree that the guarantee herein contained shall remain in full force and effect during the period that would be taken for the finalization of the said tender and that it shall continue to be enforceable till the said tender is finally decided and order placed on the successful tenderer(s) and or till all the dues of the company under or by virtue of the said tender have been fully paid and its claims satisfied or discharged or till a duly authorized officer of the company certifies that the terms and conditions of the said tender have been fully and properly carried out by the said tenderer (s) and accordingly discharges the guarantee.
6. That the Owner Company will have full liberty without reference to us and without affecting this guarantee to postpone for any time or from time to time the exercise of any of the power of the owner under the tender.
7. Notwithstanding anything contained herein before, our liability shall not exceed Rs..... (Rupees.....only) and shall remain in force till..... (Date to be filled up shall be 180 days from the date of submission of Bid).

Date.....

..... Bank  
Corporate Seal of the  
Bank By its constitutional  
Attorney

Signature of duly Authorized  
person On behalf of the Bank

With Seal & Signature code



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

## 4.0 ANNEXURE-D

### LIST OF MANDATORY SPARES

**(To be supplied along with Telescopic type bulk loading Spout with inline compact filter module, Rotary Feeder and allied equipments)**

Sr. No.	Item Description	Additional Description	UoM	Qty.	Remarks
<b><u>Spares for Telescopic type Bulk Loading Spout</u></b>					
1.	Transfer Sheave Assembly for Telescopic Spout		Set	1	
2.	Lifting cables (Outer)		Set	2	
3.	Inner cone harness cables (Inner)		Set	2	
5.	Bearings with Sleeves and Housing for Telescopic Spout	Bearing, Make-SKF/FAG	Set	1	1set of Each type of bearings
6.	Outer sleeve Assembly		Set	1	
7.	Drive Pulley Assembly		Set	1	
8.	Gearbox with Motor		Set	1	
<b><u>Spares for Inline Compact Filter Module</u></b>					
1.	Filter Cartridges		Set.	1	
<b><u>Spares for Rotary Feeder</u></b>					
1.	Bearings with Sleeves and Housing for Telescopic Spout	Bearing, Make-SKF/FAG	Set	1	1set of Each type of bearings
<b><u>NOTE TO BIDDER</u></b>			<b>SIGNATURE OF BIDDER &amp; DATE</b>		
1. ITEMS WHICH DEVIATE FROM THE SPECIFICATION SHOULD BE MARKED WITHIN ASTERISK (*) AND DETAILS TO BE GIVEN IN SCHEDULE OF DEVIATIONS.					



**Tender Document for** : Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

## **5.0 ANNEXURE - E**

### **PERFORMA CERTIFICATE**

**(No claim, No arbitration)**

To,  
Addl.General Manager (SLPP)  
Gujarat Industries Power Company Limited,  
Surat Lignite Power Plant,  
Village: Nani Naroli, Ta. Mangrol,  
Dist. Surat – 394110 (Gujarat).

Dear Sir,

**Subject:** \_\_\_\_\_

**Ref:** Work Order No.: \_\_\_\_\_ dated \_\_\_\_\_

We hereby confirm with free consent as under:-

1. The measurements certified in final bill are full and final. We accept all the certified measurements and no claim related to the measurement is left.
2. The payment certified in that or above referred Lol / contract is full and final. We accept this, and no claim related to payment is left.
3. The rates of the Lol / contract and its amendments are firm till completion of contract and extension period. We shall not claim any escalation against these rates.
4. Along with the contract referred, the ARBITRATION CLAUSE also perishes i.e. we will not resort to arbitration.
5. No extra items are left to be settled.
6. We do not have any claims against any item related to the Lol than those items certified in the bills.
7. We are accepting the recoveries or hold amount from our bills, if any, made by GIPCL against non compliance or as decided by GIPCL within terms & conditions of contract.
8. We have paid royalties, taxes for all the materials procured by us, for carrying out the works for above Lol and we indemnify GIPCL from any liability arising thereof.



**Tender Document for** : Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

9. In case of any disputes arising in future related to payment of royalties, all liabilities of settlement of dispute and its payment if any, will be borne by us.
10. We have paid wages to all the workmen who were deployed by us for carrying out above referred work as per prevailing Minimum wages act. We have also fulfilled all requirements of the P.F. Act. We have maintained all records necessary as per the statutory requirements. We hereby indemnify GIPCL from any disputes arising in future related to payment of labours, Provident Fund, etc.. and confirm that all liabilities of settlements of disputes and their payment is our responsibility.

The above confirmation will come into effect as soon as payment from final bill after due recoveries will be received by us.

For, M/s \_\_\_\_\_

Signature, Stamp and date



**Tender Document for** : Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

## 6.0 FORM - A

### List of qualifying staff to be submitted with physical documents

Sr. No.	Name of Supervisor	Qualification	Experience

Contractor / Authorized Representative's  
Signature, Company's / Organization's Seal & Date

Note: Form-A of Bid without price shall be submitted with Part-I

## 6.0 FORM -B

### List of Tools & Tackles to be submitted with physical documents

Sr. No.	Description	Nos.	Status

Contractor / Authorized Representative's  
Signature, Company's / Organization's Seal & Date

Note: Form-B of Bid without price shall be submitted with Part-I



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at "Surat Lignite Power Plant – 4x125 MW".(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

## 7.0 ANNEXURE-F

### **(Performa for daily work done report / measurement sheet)**

**Name of Work:**

**Name of Agency:**

**Work Order No.:**

**DAILY WORK DONE REPORT FOR DATE:** \_\_\_\_\_

**Name of Supervisor of Contractor:** \_\_\_\_\_

**Sign of Engineer-in-charge (to be taken at 08:30 AM to 08:45 AM):**\_\_\_\_\_



Total nos. of trips certified by me

\_\_\_\_\_  
Sign of Contractor's  
site-in-charge

\_\_\_\_\_  
(Shift-in-charge, Main Control Room)

Name: \_\_\_\_\_

Date: \_\_\_\_\_





**Tender Document for** : Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

## 8.0 ANNEXURE - G

### **Declaration Cum Undertaking for Safety Laws and Regulations Compliance**

(To be submitted on Company's Letter Head)

I \_\_\_\_\_ on behalf of.....Name of Party/Company.....hereby confirm, agree and undertake that all the Statutory and Safety Laws and Regulations of the applicable Authority/ies shall be strictly followed for all types of works at the site during the period of the Contract, if awarded to me.

Signed and Stamped by the  
Authorized Signatory  
Of the Bidder

---

## 9.0 ANNEXURE- H

### **Declaration for Contractual Disputes/ Litigations**

(To be submitted on Company's Letter Head)

**Please tick (✓) whichever is correct option**

I \_\_\_\_\_on behalf of .....Name of Party/Company.....hereby confirm that I/We have

- a. Not invoked legal recourse e.g. litigation against any Govt, of Gujarat Undertakings / Depts. / Authorities and Govt. of Gujarat supported companies / undertakings / organizations for the last three (03) years. There are no ongoing/pending legal matter(s) with any of the Govt. of Gujarat Undertakings / GoG supported Companies, including GIPCL.

OR

**Please Tick ( )**



**Tender Document for** : Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

- b.** Invoked legal recourse e.g. litigation against any Govt, of Gujarat Undertakings / Depts. / Authorities and Govt. of Gujarat supported companies / undertakings / organizations for the last three (03) years.

**Please Tick ( )**

If “b” is applicable, please submit the details for the same.

The above is true, as on date, to the best of my knowledge. Any breach/ false statement in this regard shall amount to disqualification of the Bid being submitted herein.

Signed and Stamped by the  
Authorized Signatory  
Of the Bidder



**Tender Document for** : Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

## 10. ANNEXURE - I

### **Schedule of Deviation from Technical Specification and Commercial Terms and Conditions**

All the deviations from the terms & conditions of contract shall be filled by BIDDER clause by clause in this schedule.

Sr. No	SECTION	CLAUSE NO	AS PER TENDER DOCUMENT	DEVIATION

The bidder here by certifies that the above mentioned are the only deviations from OWNER’s Tender enquiry. The bidder further confirms that in the events any other data and information presented in the BIDDER’s proposal and accompanying documents are at variance with specific requirements laid out in the OWNER’s Tender Document, then the latter shall govern and will be binding on the BIDDER for quoted price.

**Company’s Seal**

**Signature .....**

**Name .....**

**Designation .....**

**Company .....**

**Date .....**



**Tender Document for** : Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

## 11.0 ANNEXURE – J

### PARTICULARS OF THE BIDDER

Sr. No.	Particulars	Please provide Information here
1.	Name of the Bidder	
2.	a. Registered office address :  b. Address for correspondence:  c. E-mail ID:	
3.	Contact details :  Contact Person Name:  Telephone No.  Mobile No.	
4.	Year of establishment  PAN No. GST No.	

COMPANY SEAL

SIGNATURE.....

NAME.....

DESIGNATION.....

COMPANY.....

DATE.....



**Tender Document for :** Design, Engineering, Supply, Erection, Testing and Commissioning of Telescopic type bulk loading Spout along with inline compact filter module, Rotary Feeder and allied equipments for unloading Fly Ash from Fly Ash Silo at “Surat Lignite Power Plant – 4x125 MW”.(Bid No.: SLPP/AHS / TELESCOPIC SPOUT/ 2020-21).

## 12.0 ANNEXURE – K

### ETHICS PACT

#### GUJARAT INDUSTRIES POWER COMPANY LIMITED

PO : PETROCHEMICAL, DIST : BARODA – 391346

Reference PO No.

Date:

Integrity Pact No.:

Contract Period:

#### OUR ENDEAVOUR

To create an environment where Business Confidence is built through best business practices and is fostered in an atmosphere of trust and respect between providers of goods and services and their users for the benefit of stakeholder, society and the nation.

GIPCL'S COMMITMENT	PARTY'S COMMITMENT
To maintain the highest ethical standards in business and professions	Not to bring pressure / recommendation from outside GIPCL to influence its decision.
To ensure maximum transparency to the satisfaction of all stakeholders.	Not to use intimidation, threat, inducement or pressure of any kind on GIPCL or any of its employees.
To fulfill the terms of agreement / contract and to consider objectively the viewpoints of other stakeholders.	To be prompt and reasonable in fulfilling the contract, agreement and legal obligations.
To ensure regular and timely release of payments for works done/services provided	To provide goods and / or services timely as per agreed quality and specifications.
To ensure that no improper demand is made by employees or by anyone on our behalf.	To maintain the general discipline in our dealings and transactions.
To give maximum possible assistance to all the Vendors / Suppliers / Service Provider and others to enable them to complete the works in time.	To be truthful and honest in furnishing information.
To provide all necessary information to suppliers /contractors relating to contract / job to facilitate them to complete the contract / job successfully in time.	Not to divulge to others any information, business details about GIPCL made available during the course of business relationship without the written consent of GIPCL.
To ensure that no hurdles are caused to vendors / suppliers / contractors in execution of agreement / contract / work .	Not to enter into cartel / understanding whether formal or informal so as to influence the price.

Seal & Signature  
(GIPCL's Authorized signatory)

Name :

Designation :

Seal & Signature  
(Party's Authorized signatory)

Name :

Designation :